






Date: Monday 01 Apr 2019

BSUoS Charge Estimate: £1.52/MWh
Total Outturn: £1.76m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

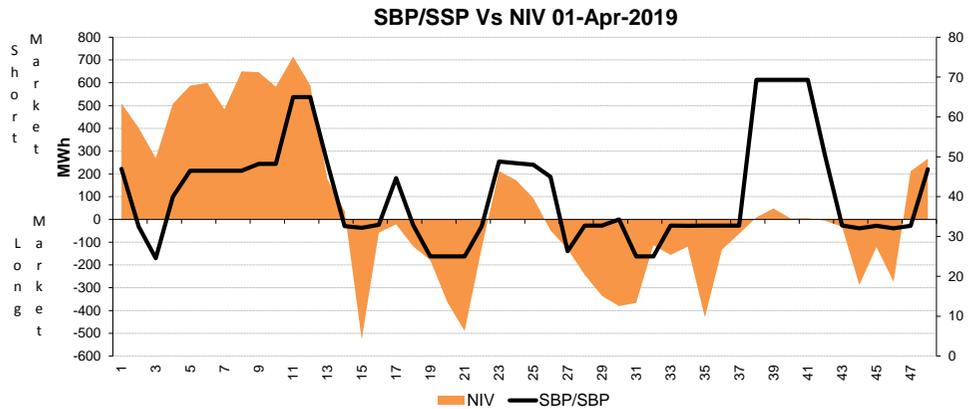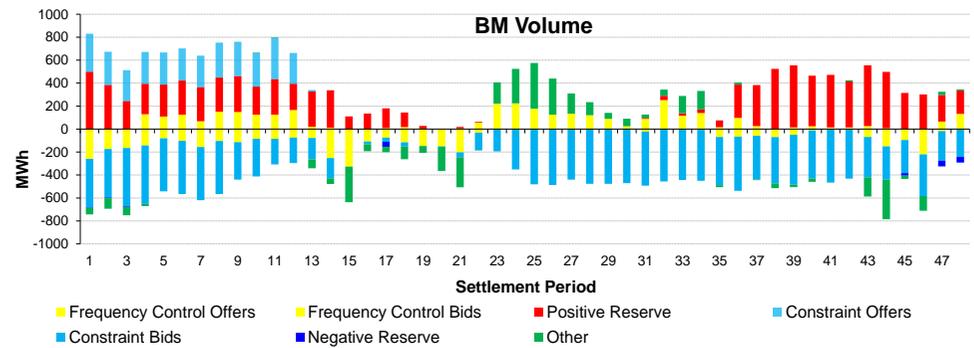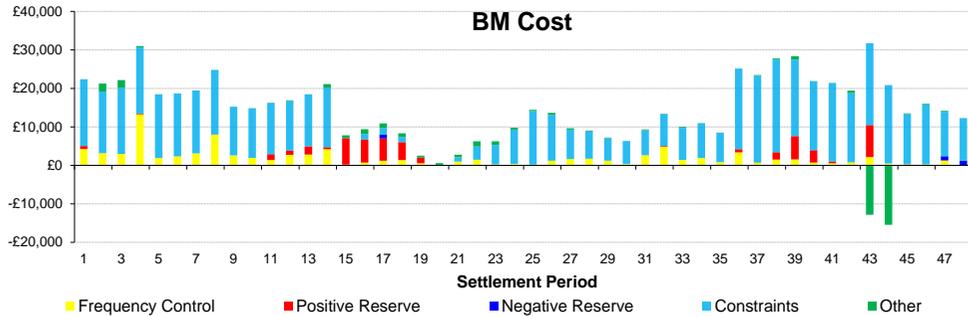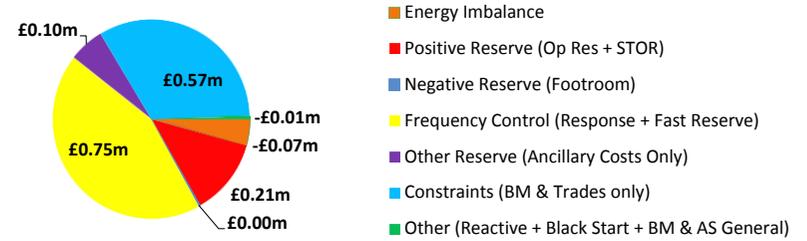

Western Link status: Available

Commentary

The market was short in excess of 1200MW overnight until the morning peak. For the rest of the day it was prevalently long. Around 200MW of STOR was run in the morning as demand was out turning higher than forecast. Spin gen was run between the afternoon and the late evening due to interconnectors swing. BM actions to solve power flow restrictions in Scotland and in England due to planned outages were taken from the midmorning. Overnight, multiple trades on the interconnectors and on some generating units were taken for RoCoF. In the evening some additional BM actions were required for RoCoF. BM actions were also taken overnight to manage the voltage levels in England.