



Date: Thursday 11 Apr 2019




BSUoS Charge Estimate: £0.85/MWh
Total Outturn: £0.78m

Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

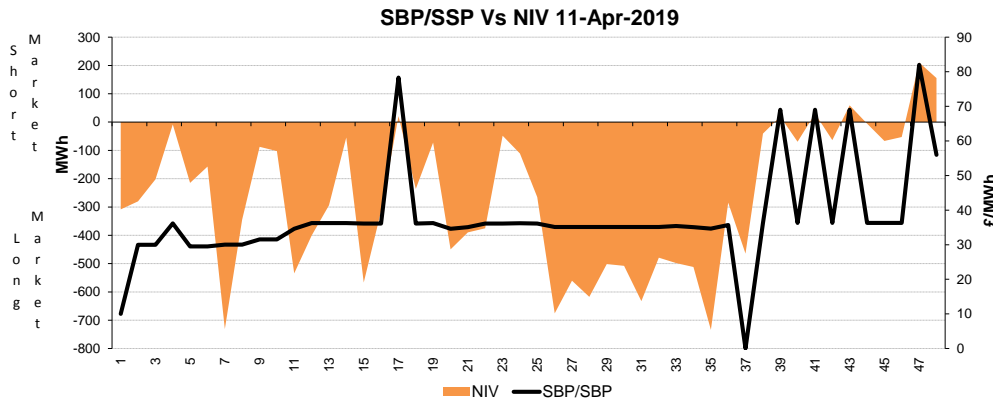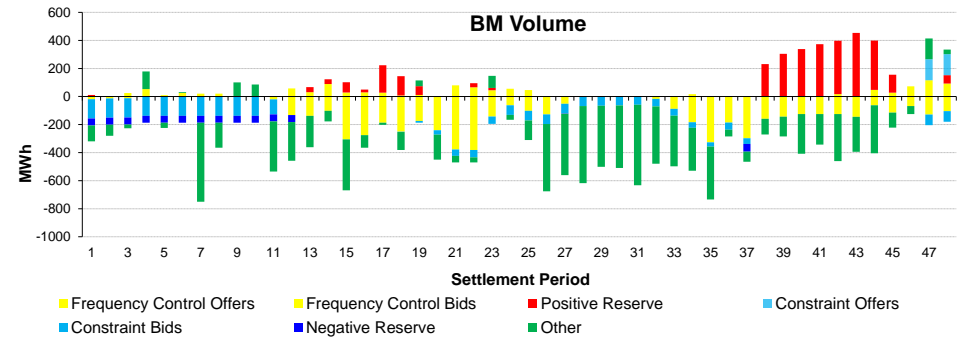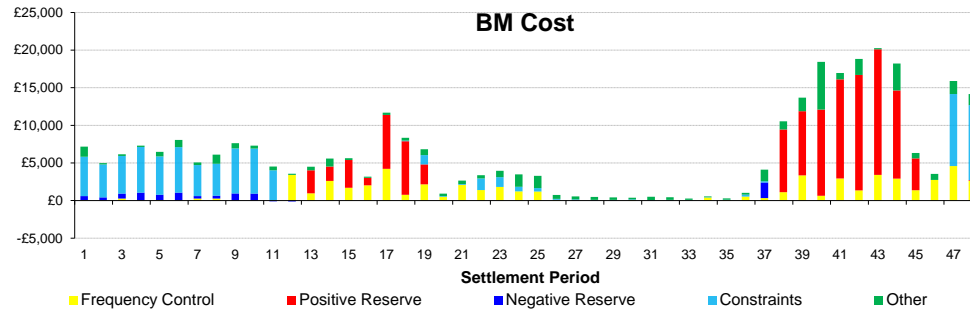

Western Link status: Unavailable

Commentary

The market was prevalently long throughout the 24 hours. Overnight, trades on the interconnectors were taken for frequency response. Between the morning and the afternoon, BM actions were taken to solve power flow congestions in the Wales area due to planned outages. Overnight, trades on interconnectors and on generating units were taken for RoCoF.