
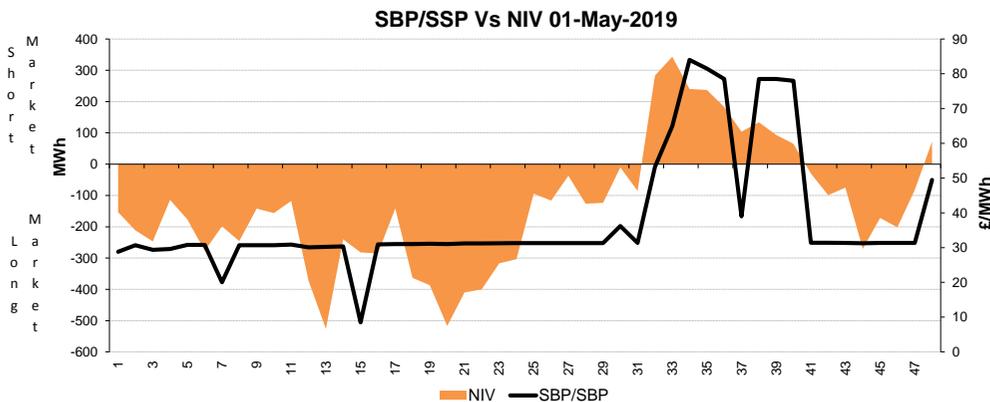
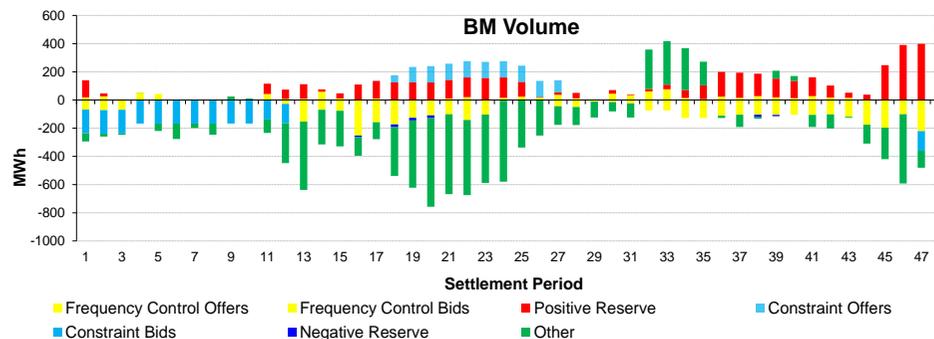
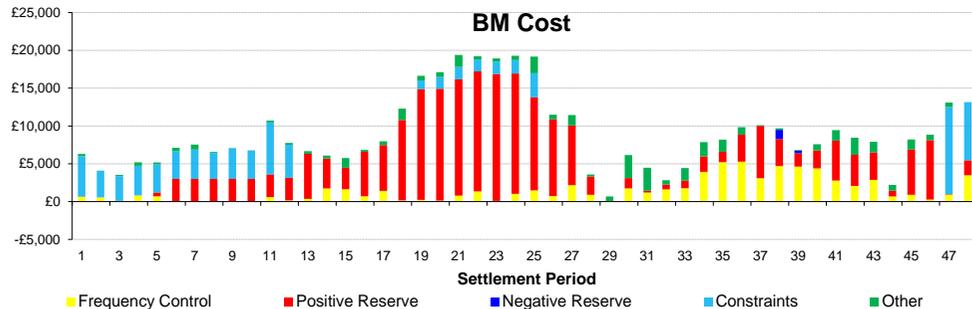
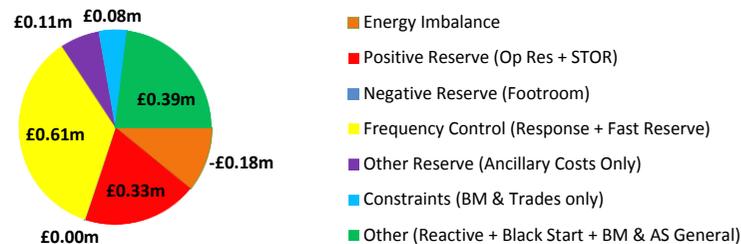


Date: Wednesday 01 May 2019

BSUoS Charge Estimate: £1.26/MWh
Total Outturn: £1.34m

Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



Western Link status: Unavailable

Commentary

The system was long for the majority of the day, up to 1GW at times, but swung short over the darkness peak. A small amount of demand side STOR was utilised over the darkness peak. Trades on the interconnectors and BMUs were used to manage ROCOF levels overnight. Some Spin Gen was used to manage voltage levels at the end of the day, all other requirements were met by the market.