
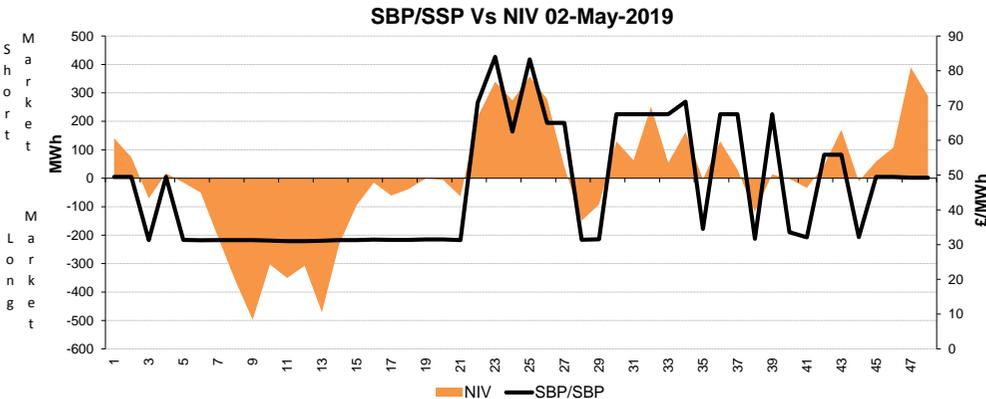
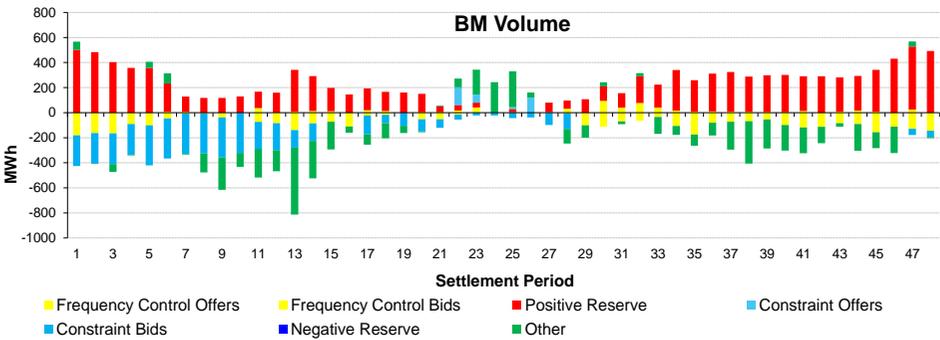
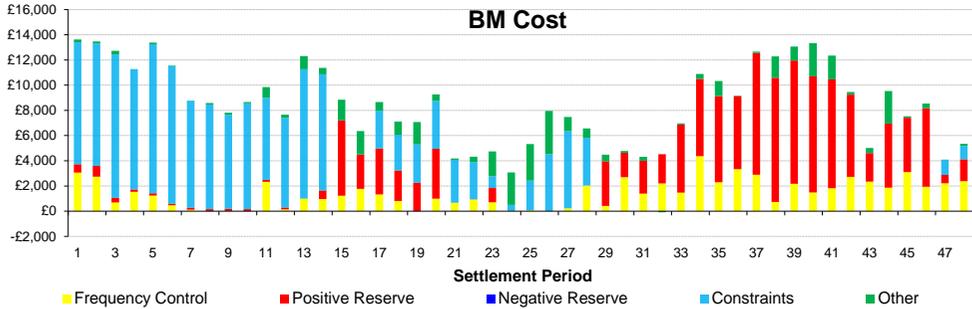
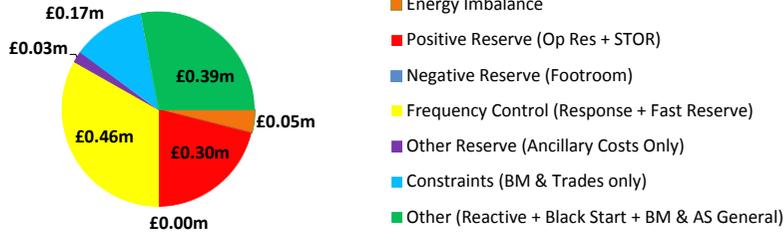


Date: **Thursday 02 May 2019**

BSUoS Charge Estimate: £1.32/MWh
Total Outturn: £1.40m

Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



Western Link status: Unavailable

Commentary

System was long through the overnight and morning before fluctuating between short and long through the afternoon and evening. Trades were done on the interconnectors for positive reserve during the morning pick up. 311MW of STOR was utilised as the system flipped short around lunchtime. Additional response and spin gen were both utilised at times during the day due to demand uncertainty. Trades on the interconnectors and BMUs were used to manage ROCOF levels overnight. BM actions were taken to manage power flow restrictions on the system due to planned outages.