



Date: Wednesday 15 May 2019




BSUoS Charge Estimate: £1.34/MWh
Total Outturn: £1.26m

Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

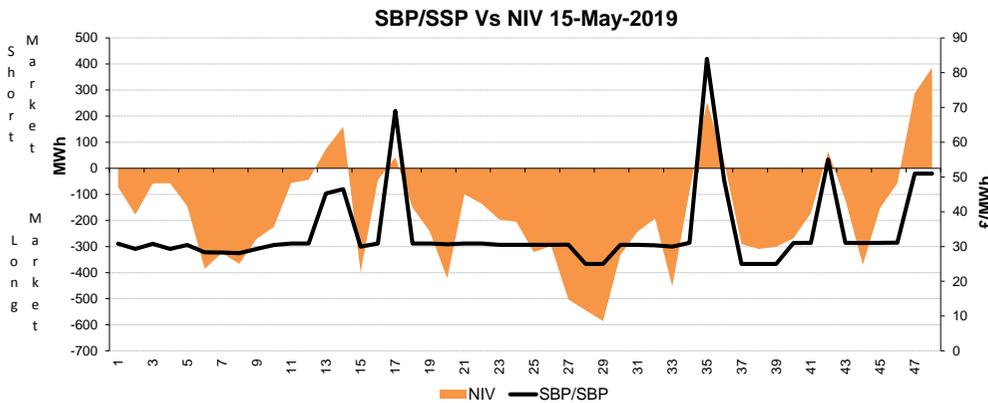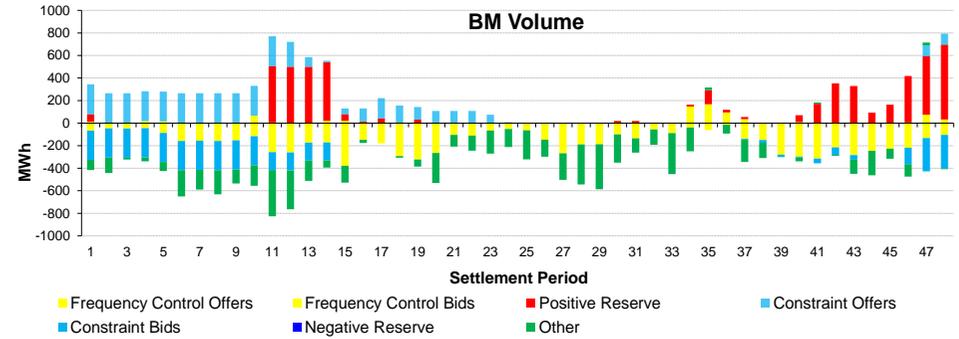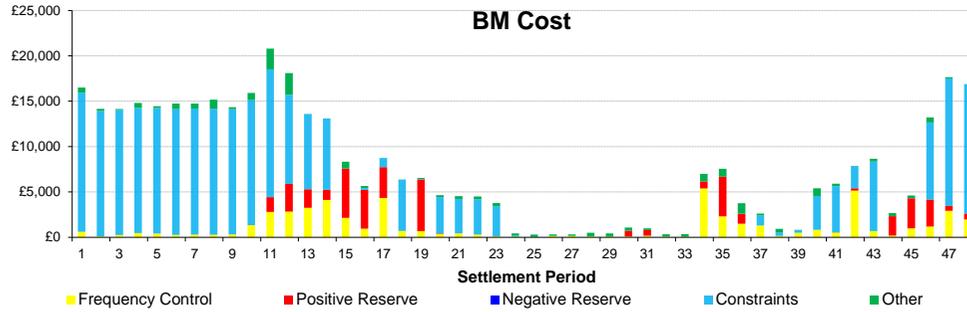

Commentary

With the sunny weather and low wind caused the market to be prevalently long throughout the day. Over the morning pick up around 1000MW were traded on the interconnectors for positive margin. Actions taken via both BM Actions and trades for voltage support and system inertia. Thermal constraints active in South Wales due to transmission outages.

Western Link status: Unavailable