
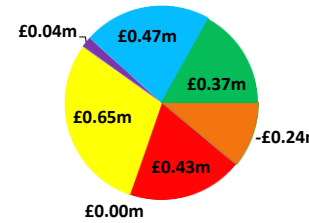


Date: **Friday 17 May 2019**




**BSUoS Charge Estimate: £1.60/MWh**  
**Total Outturn: £1.72m**

# Daily Balancing Costs

■ BM Cost (Indicative)  
 ■ AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

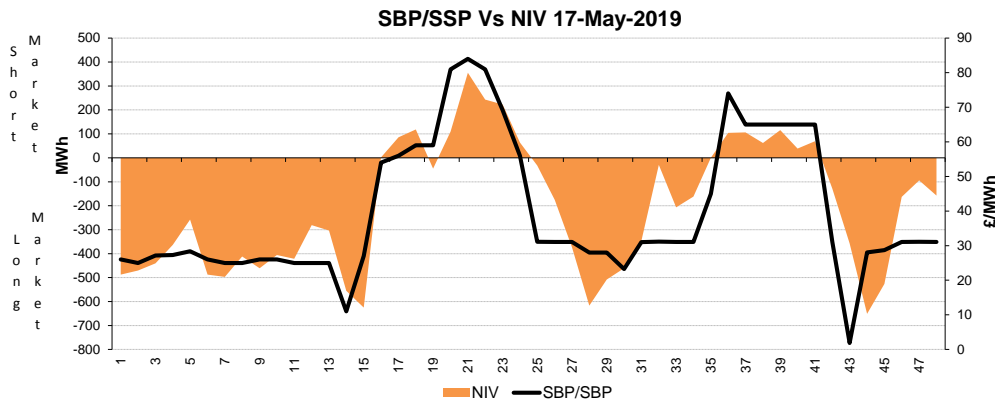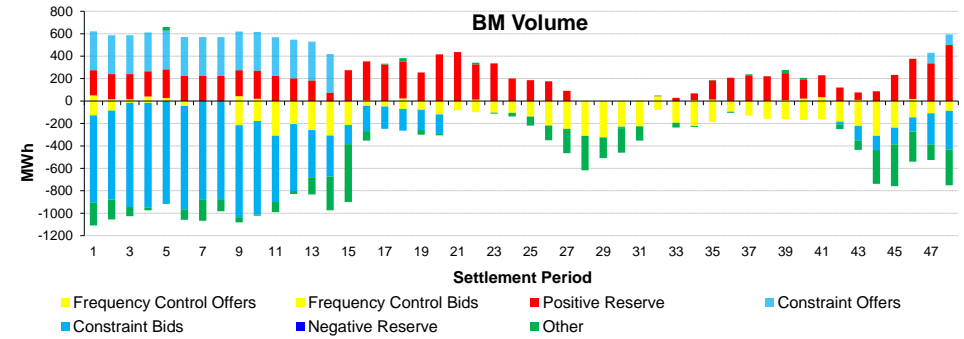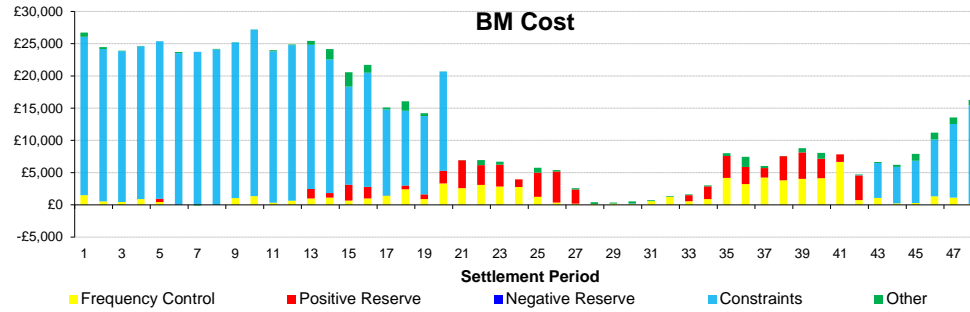

## Commentary

Comfortable margins even with the low wind forecast and solar energy, the later picking up to around 4GW. Actions taken for System linetair via BM during the early morning. Voltage control trades throughout the day due to low wind forecast.

**Western Link status: Unavailable**