
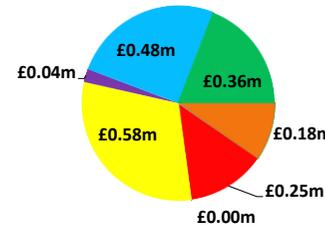


Date: Saturday 18 May 2019




BSUoS Charge Estimate: £1.89/MWh
Total Outturn: £1.89m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

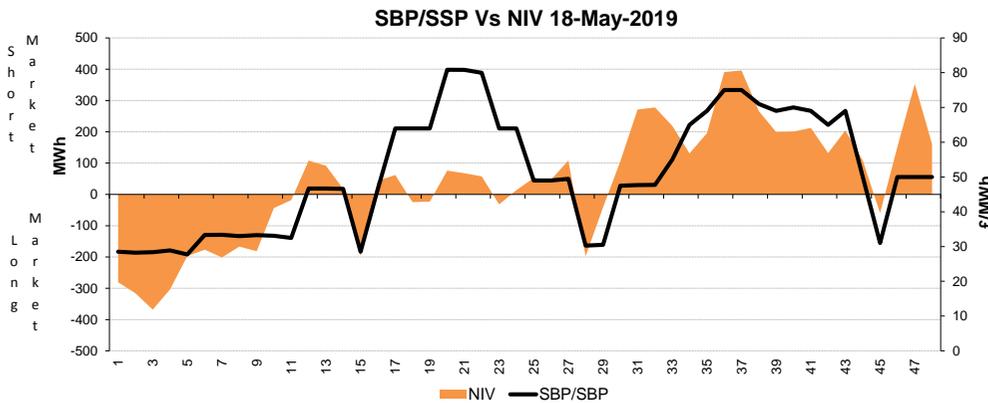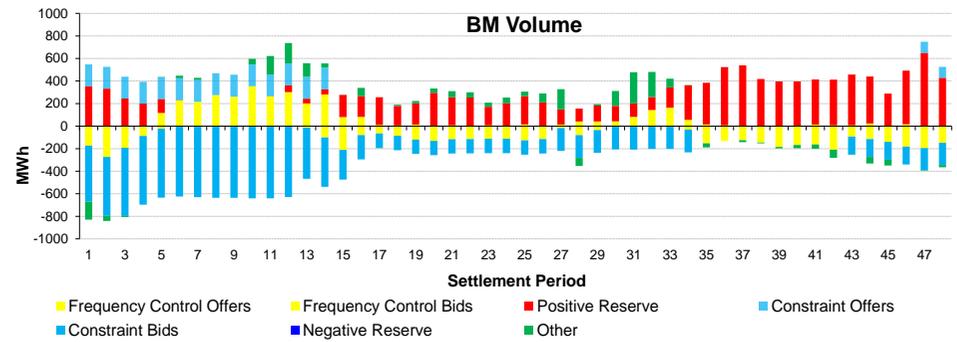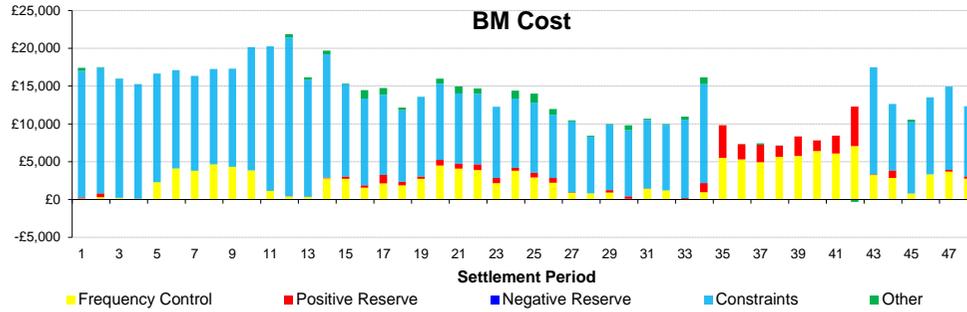

Commentary

Interesting day with low wind levels caused the energy to flow from north to south which was covered by good margins
System Inertia controlled through out the day via BM actions and trades

Western Link status: Unavailable