
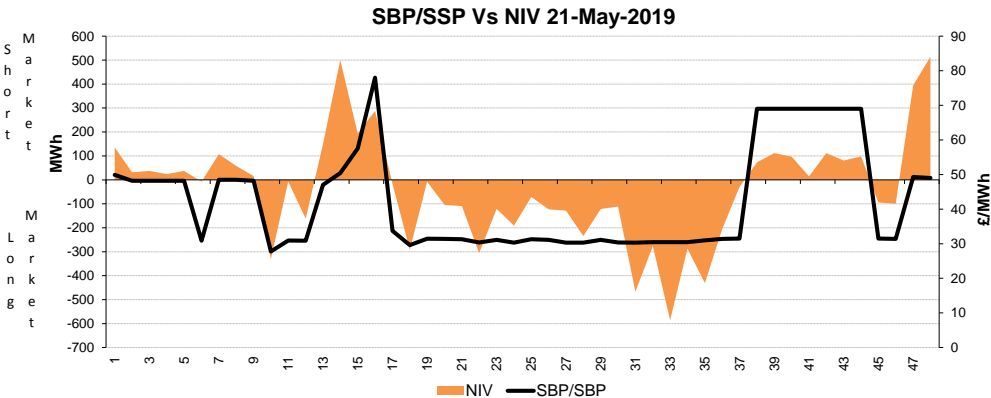
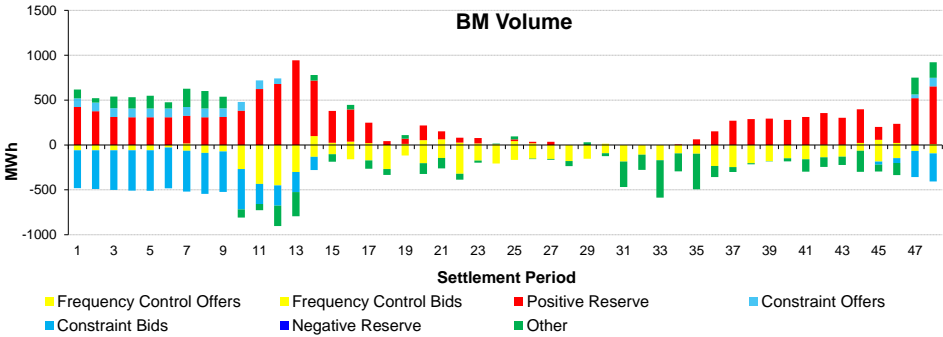
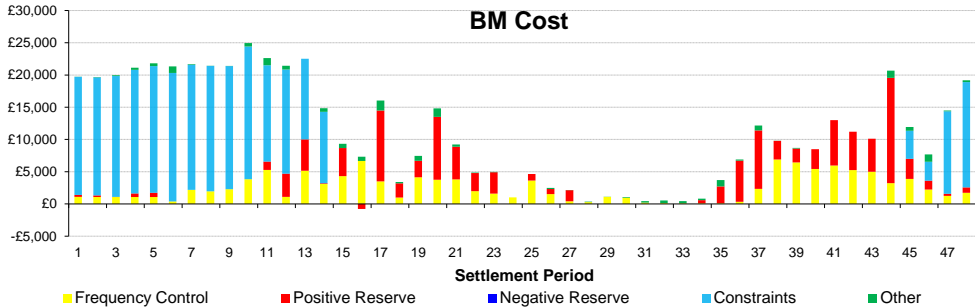
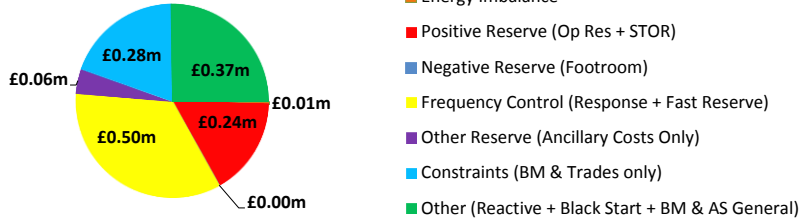


Date: **Tuesday 21 May 2019**

**BSUoS Charge Estimate: £1.50/MWh**  
**Total Outturn: £1.47m**

# Daily Balancing Costs

■ BM Cost (Indicative)  
 ■ AS Cost (Estimate)



**Western Link status: Unavailable**

### Commentary

System was mainly long through the daytime but swung short through the morning pick up and darkness peak. Trades were conducted on the interconnectors for positive reserve over the morning pick up and additional response was also held due to interconnector swings. Trades were done on the interconnectors and BMUs along with BM actions to manage ROCOF levels overnight. BM actions were also required to manage voltage levels in the Midlands.