



Date: **Monday 17 Jun 2019**

BSUoS Charge Estimate: £3.05/MWh
Total Outturn: £3.39m




Daily Balancing Costs

BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

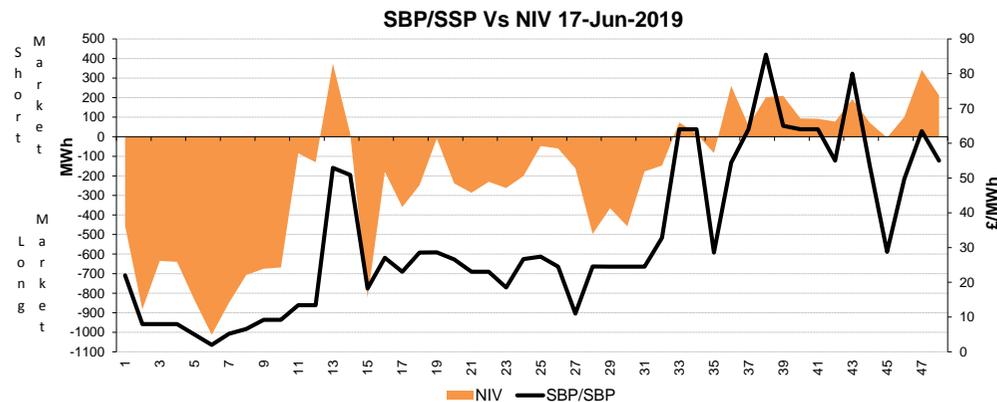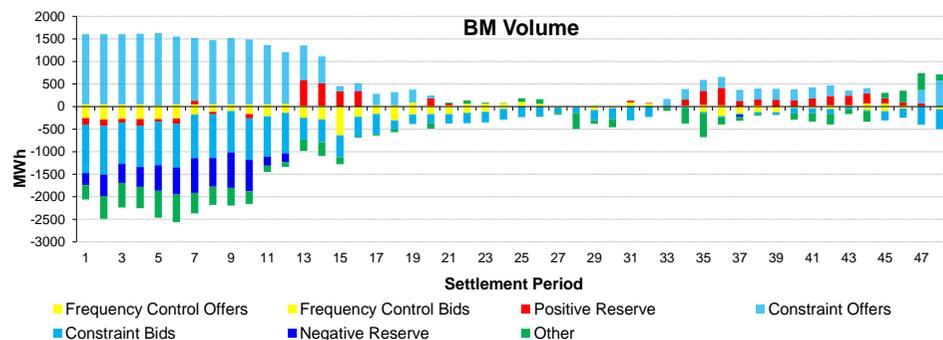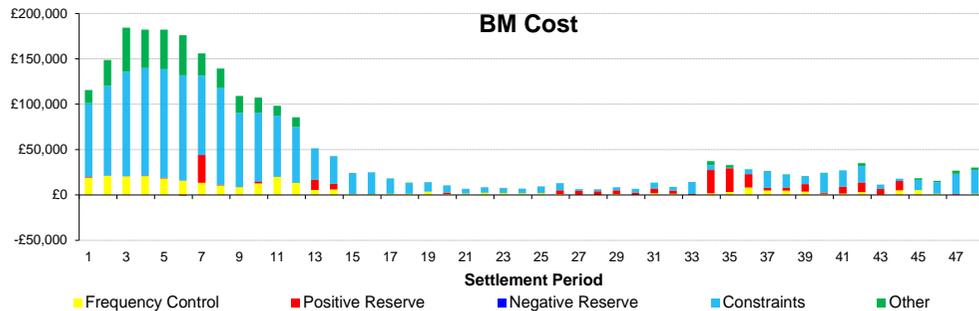

Western Link status: Available

Commentary

Long market the majority of the day with periods of demand uncertainty due to the weather conditions saw more offers taken. Trades made for both margin and negative regulating reserve during the early morning.

Control and System Inertia issues have been the main concern over the day with the yellow weather warnings issued for the midlands and the south of the UK necessitating Interconnector Trades and BM actions.