



Date: **Saturday 01 Jun 2019**

BSUoS Charge Estimate: £4.12/MWh
Total Outturn: £4.21m




Daily Balancing Costs

BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

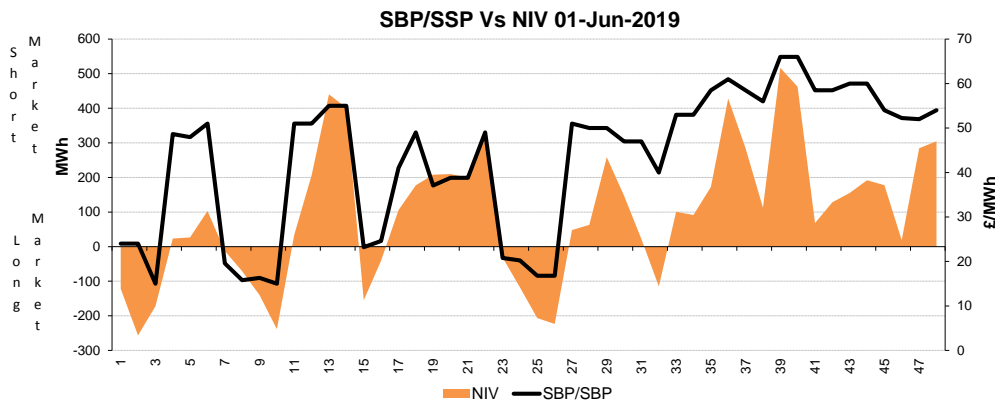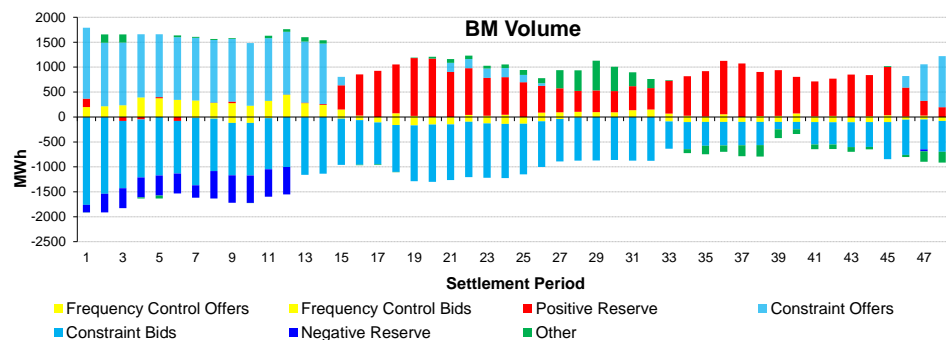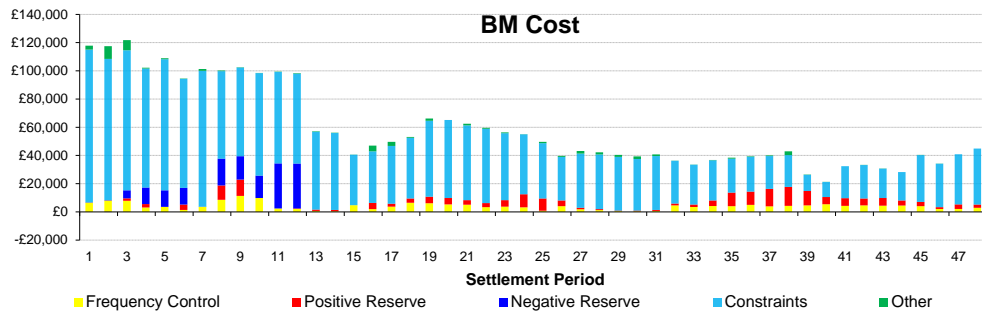

Western Link status: Unavailable

Commentary

A mixed market in the morning saw NIV flipping between long and short, which then leveled out over the evening. STOR brought between settlement periods 16 to 24.

Interconnector trades and BM actions taken throughout the day for system inertia and voltage control. Areas of particular concern were east coast, south Wales and midlands