
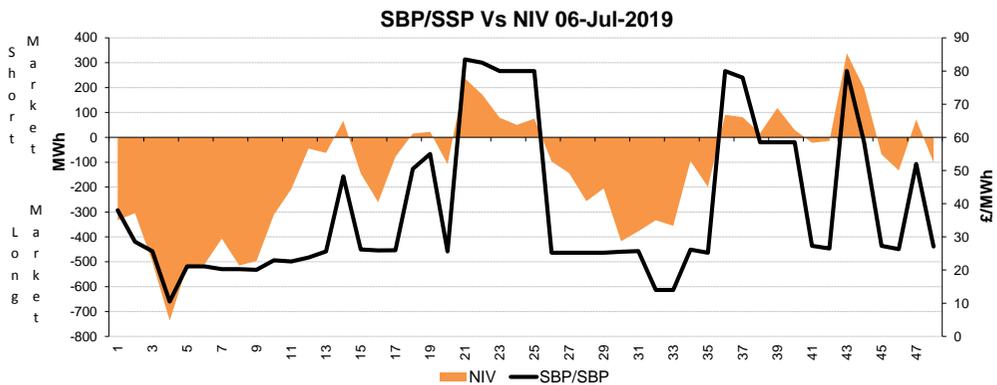
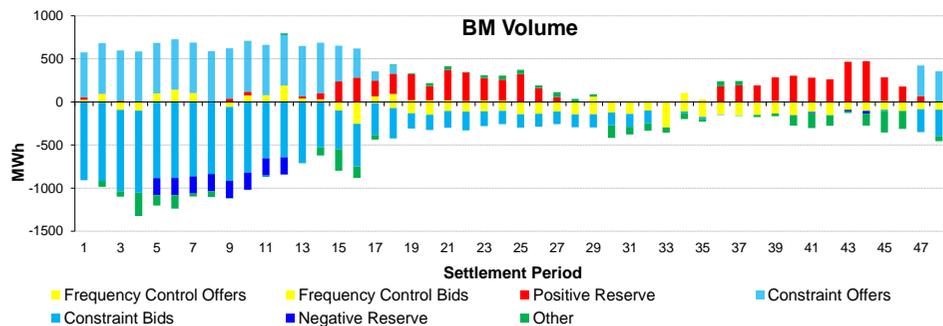
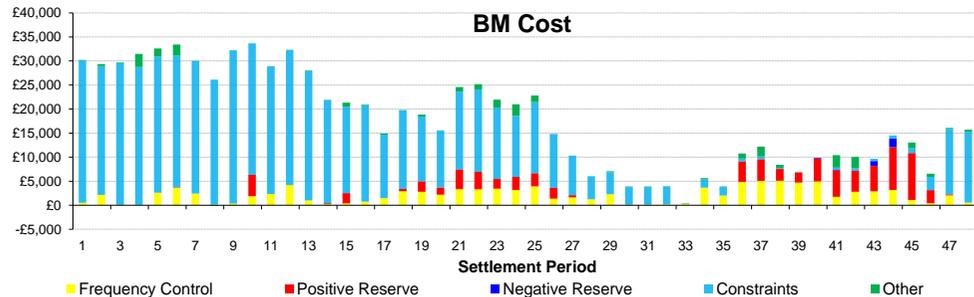
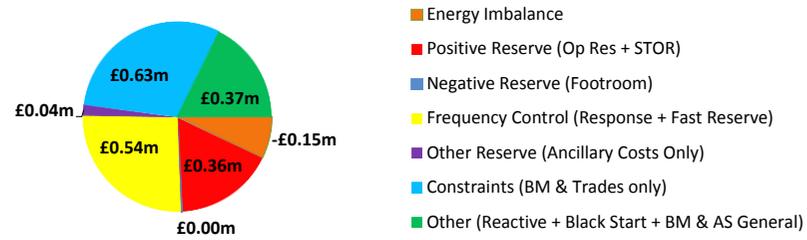


Date: Saturday 06 Jul 2019

BSUoS Charge Estimate: £1.97/MWh  
Total Outturn: £1.80m

# Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



**Western Link status: Available**

## Commentary

NIV flipped between long and short throughout the day. Trades were taken for downward margin during the early morning. NBM STOR between SP 20 and 24 due to forecast embedded generation errors.

Voltage Support in the SE Coast of England, West Midlands and South Wales resolved using a mixture of Trades and BM actions. System Inertia around North Yorkshire remediated through Trades and BM Actions throughout the day.