
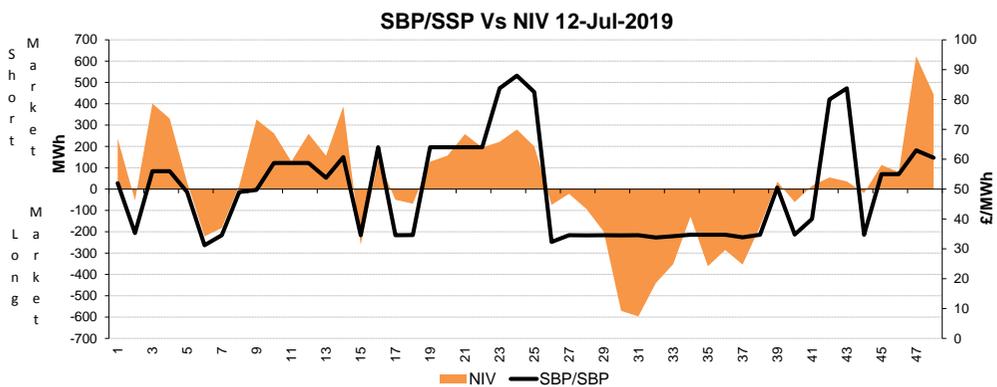
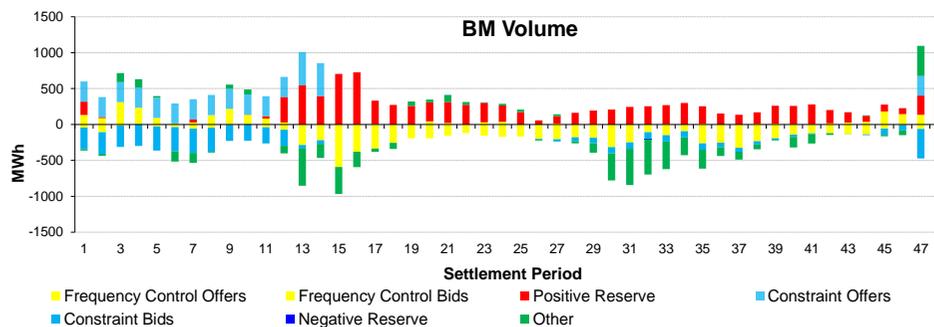
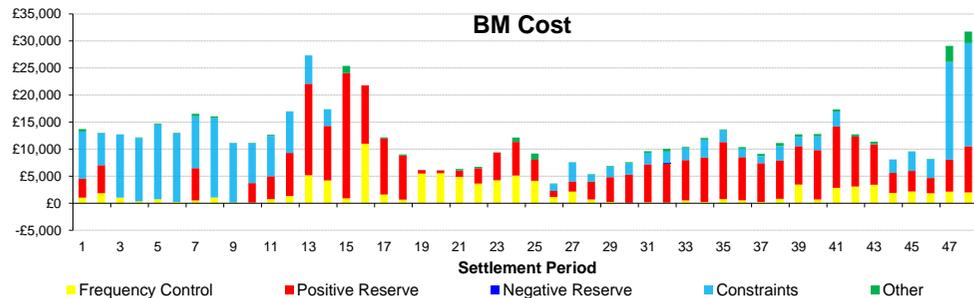
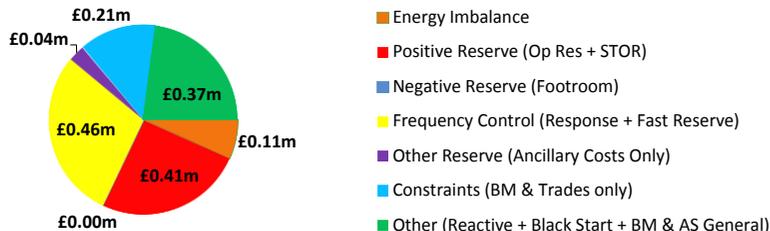


Date: Friday 12 Jul 2019

BSUoS Charge Estimate: £1.64/MWh
Total Outturn: £1.60m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

A fairly benign weather day with low wind set off with high solar energy generation. With generation losses and demand pull STOR was called off between SP 23 and 24. Interconnector trades were made in the morning for margin.

System Inertia and voltage control around Central and North England, East Coast were resolved using trades.

Western Link status: Available