
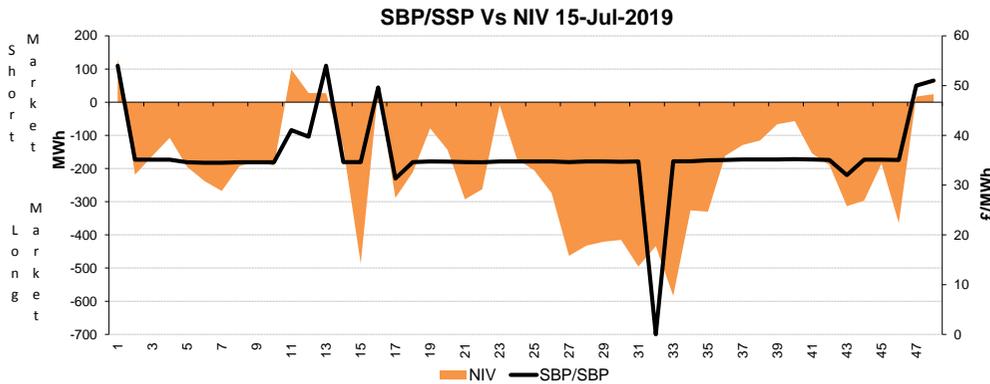
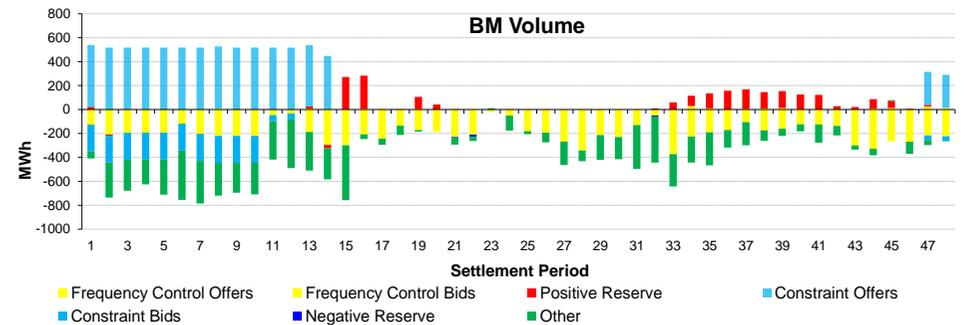
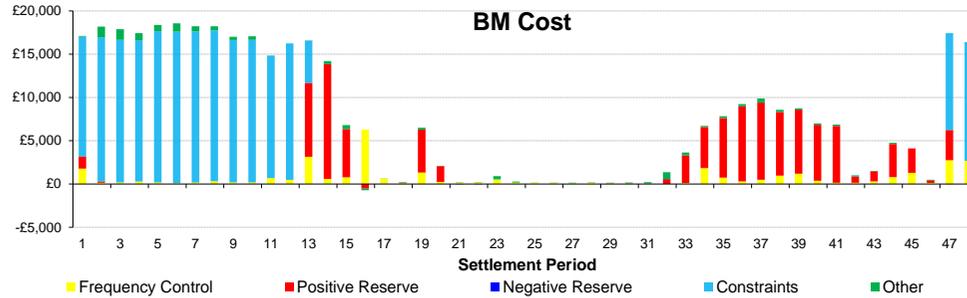
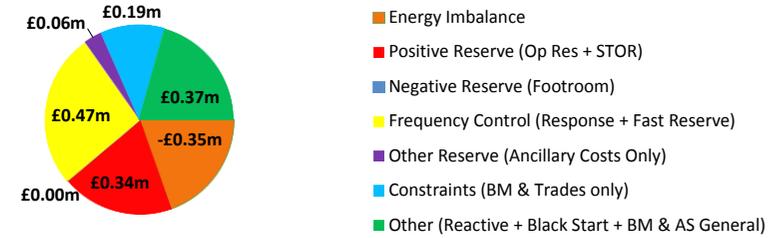


Date: **Monday 15 Jul 2019**

BSUoS Charge Estimate: £1.24/MWh
Total Outturn: £1.11m

Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



Western Link status: Available

Commentary

Comfortable margins with low forecasts for both wind and solar embedded generation, left NIV predominantly long throughout the day with a maximum 584MWh in SP 33.

Voltage control issues in the South Wales, East Coast, Central to North Midlands resolved using Trades and BM Actions. System inertia mitigated via trades alone.