






Date: Thursday 25 Jul 2019

BSUoS Charge Estimate: £2.68/MWh
 Total Outturn: £3.22m

Daily Balancing Costs



BM Cost (Indicative)
 AS Cost (Estimate)

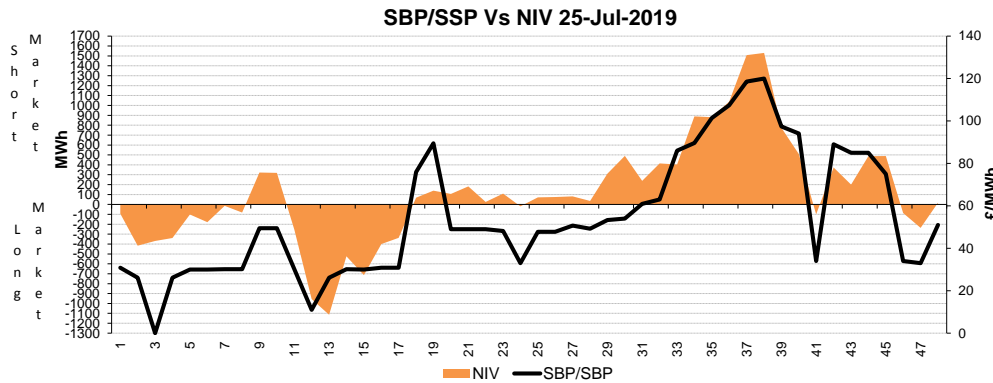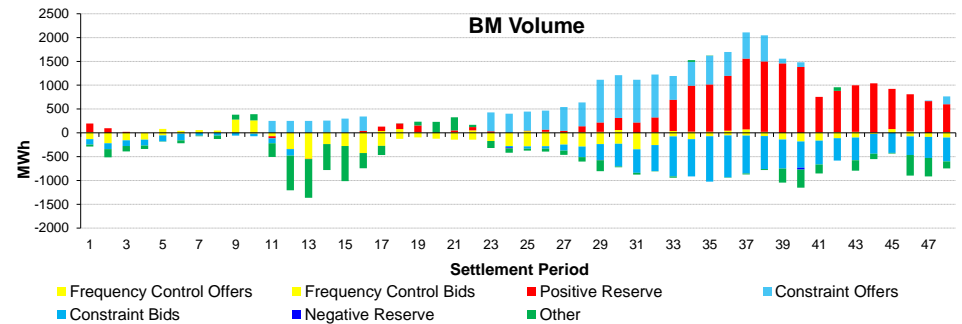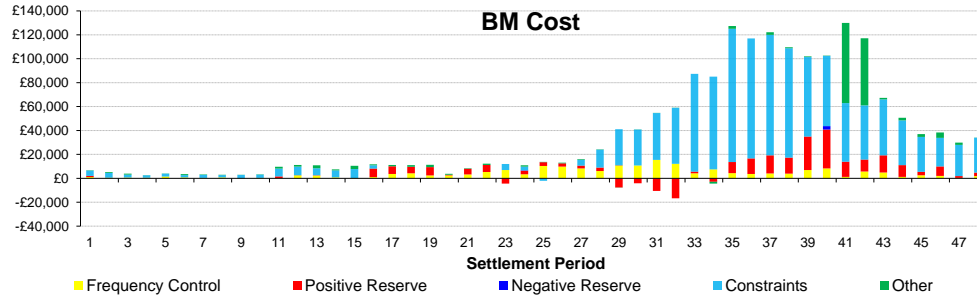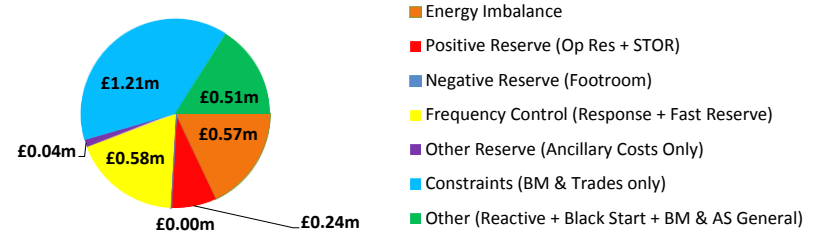

Western Link status: Available

Commentary

With the exceptionally warm conditions experienced on the day, demand forecasting was challenging and the ambient conditions led to plant shortfalls. Generation losses was experienced going into the evening peak, where approximately 600MW of STOR was called off to manage the shortfall.

Market activity provided the bulk of voltage management; only one BM Action was needed to manage voltage issues in the South of England. Interconnector trades were placed to manage constraint issues in the south of England in the early morning period and from midday through to the evening period.