
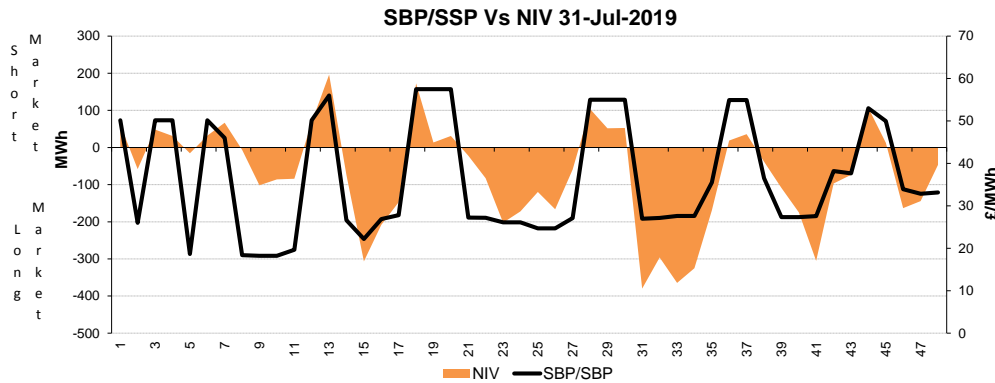
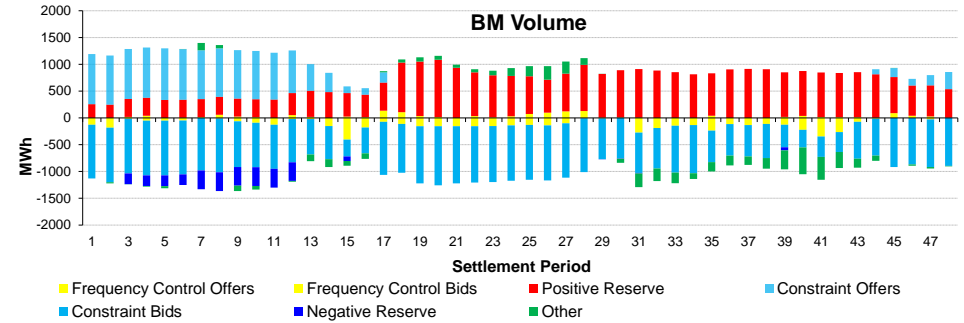
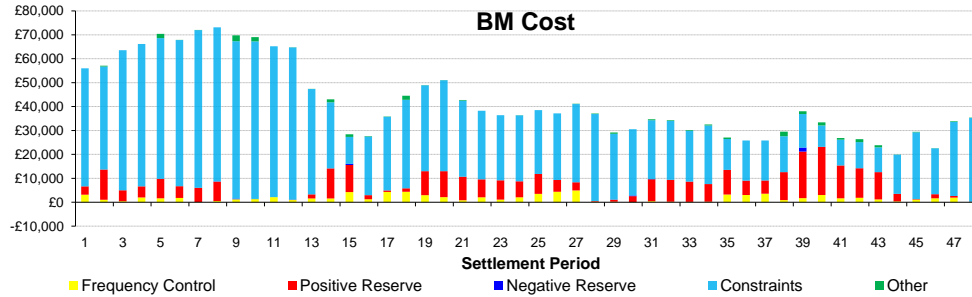
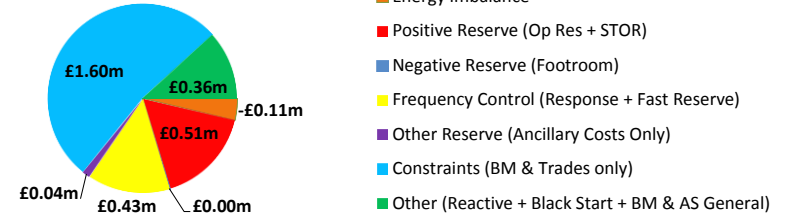


Date: Wednesday 31 Jul 2019

BSUoS Charge Estimate: £2.61/MWh
Total Outturn: £2.83m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Western Link status: Available

Commentary

In the morning between 08:00 to 11:00 450MW of STOR was run. The market was mostly long for the duration of the day, with occasional short peaks intermittently. Multiple trades were taken across interconnectors to manage Power flow constraints from the morning through to the night. During the early hours BM actions were taken to manage Voltage constraints around the midlands and east coast, alongside interconnector trades for system inertia.