
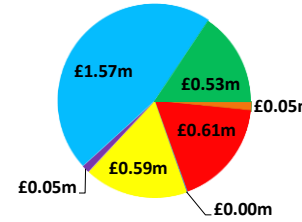


Date: Friday 03 Jan 2020




BSUoS Charge Estimate: £2.47/MWh  
Total Outturn: £3.40m

# Daily Balancing Costs

- BM Cost (Indicative)
- AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

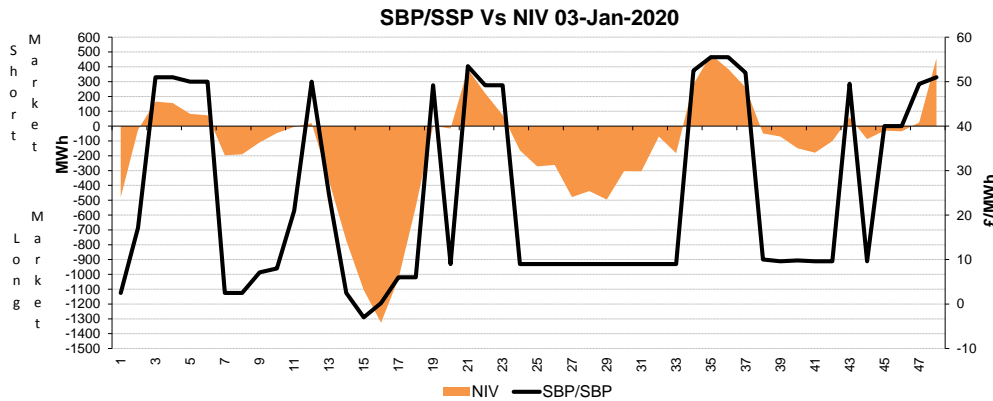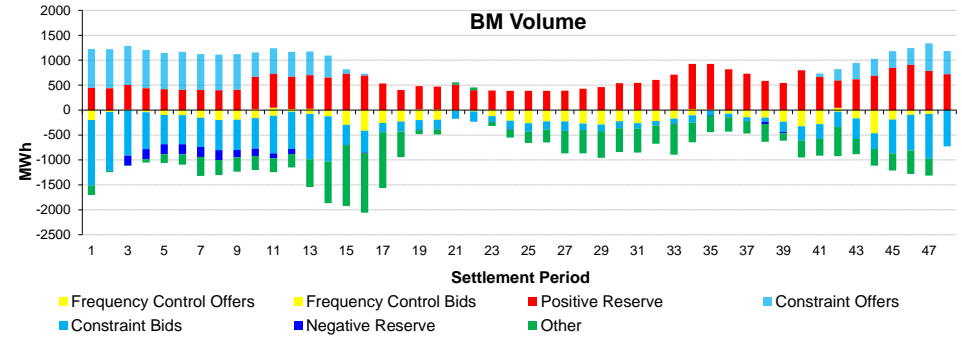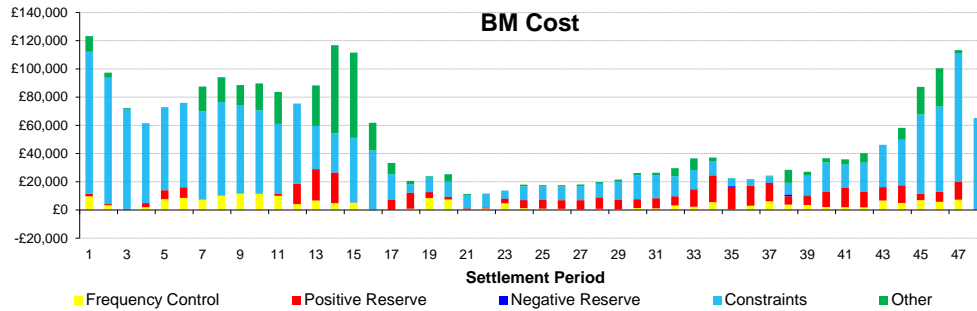

## Commentary

Early morning forecast differences were observed. Trades for margin were made between 1:30am and 6am.

Overnight trades were carried out on interconnectors. Trades were required for RoCoF. BM Actions and trades were made for voltage management.

Western Link status: Available