

Date:


Sunday 24 Apr 2022

BSUoS Charge Estimate: £10.59/MWh

Total Outturn: £9.85m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

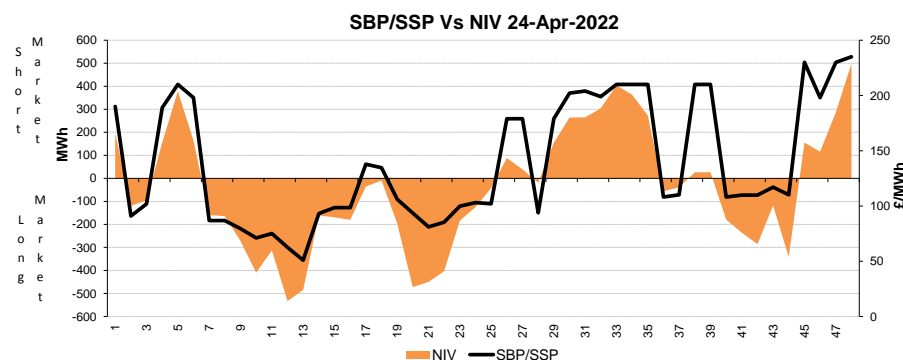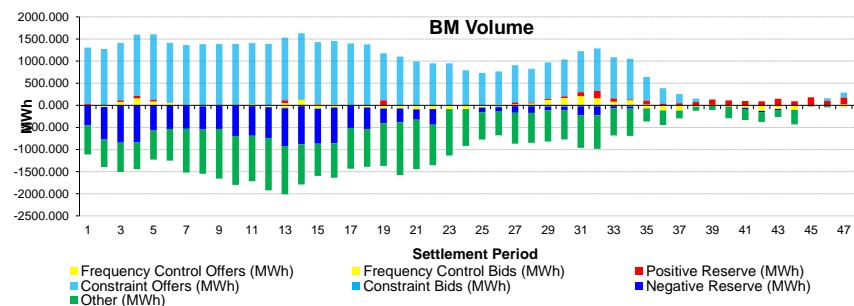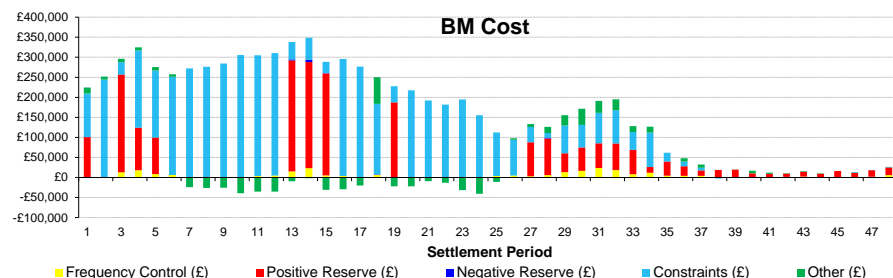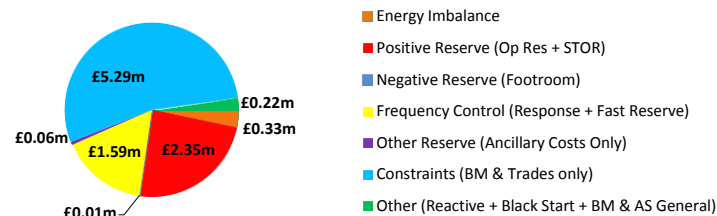

Commentary

A long market over the morning to midday period, becoming short over the afternoon and in the late night. Interconnector Trades required overnight and into the day until the late afternoon for Downward Regulation. Trades and BM Action supported overnight Voltage Control, with BM Action required ongoing into the day. BM Action for System Inertia from morning to the late afternoon. Thermal export constraints in the East of England were alleviated by BM Action in the afternoon.