


Date: Saturday 02 Apr 2022

BSUoS Charge Estimate: £3.26/MWh
Total Outturn: £3.51m


BM Cost (Indicative)

AS Cost (Estimate)






Daily Balancing Costs

nationalgridESO

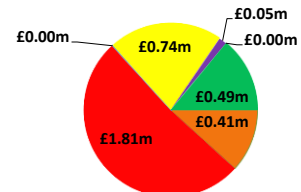

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

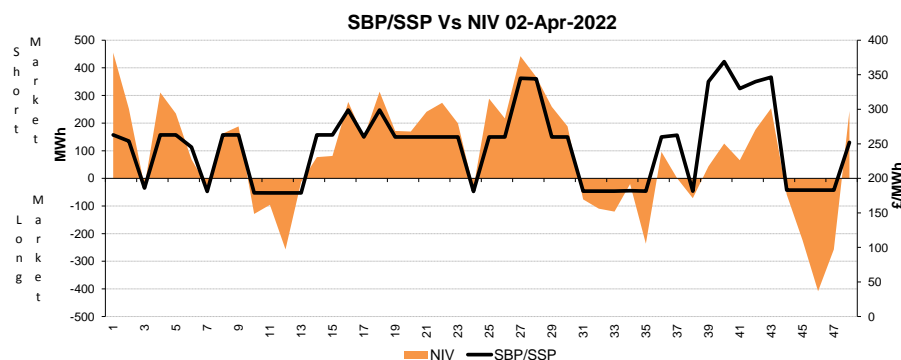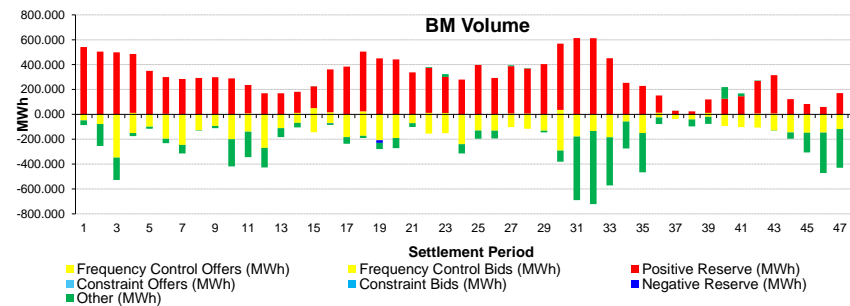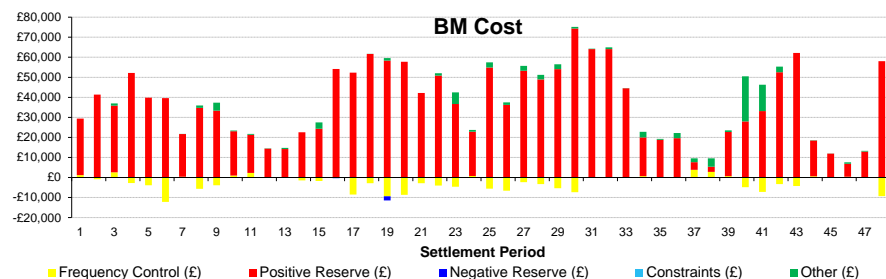

Commentary

A mostly short market throughout the day.

No active constraints and no plant required for system reasons in the BM. All overnight Voltage requirements met by the market.