

Date:


Sunday 03 Apr 2022

BSUoS Charge Estimate: £7.14/MWh

Total Outturn: £8.20m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

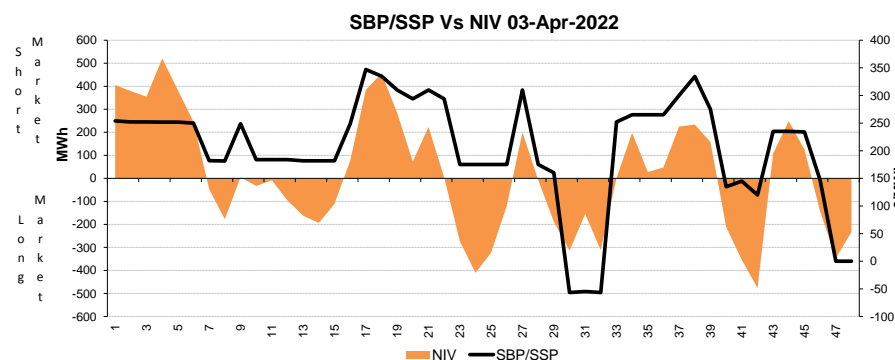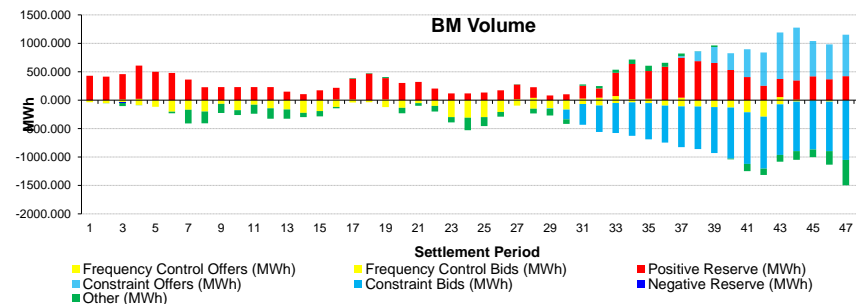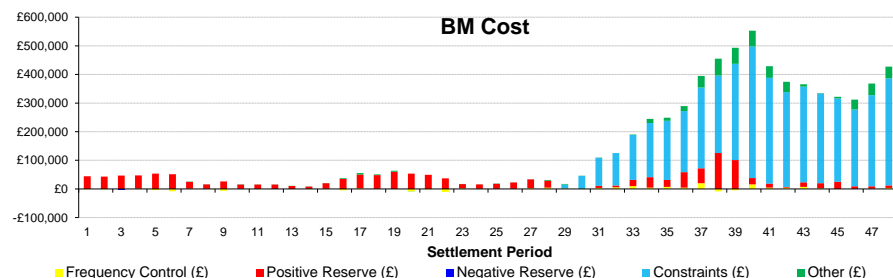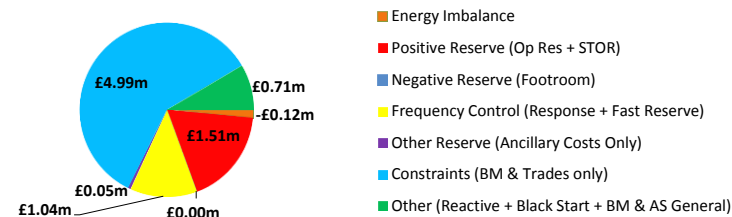

Commentary

The market was short overnight to the early hours of the day, over the morning peak, the late afternoon, and during the late evening.

Overnight Voltage Control supported by Trades in the Midlands and the South East of England. BM Action required for System Inertia overnight. BM Action alleviated thermal export constraints in Scotland from the early afternoon onwards. BM Action managed thermal import constraints in the South East of England and power flow constraints from the North of the UK to the South during the early evening to late evening period.