

Date:


Friday 22 Apr 2022

BSUoS Charge Estimate: £3.56/MWh

Total Outturn: £3.26m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

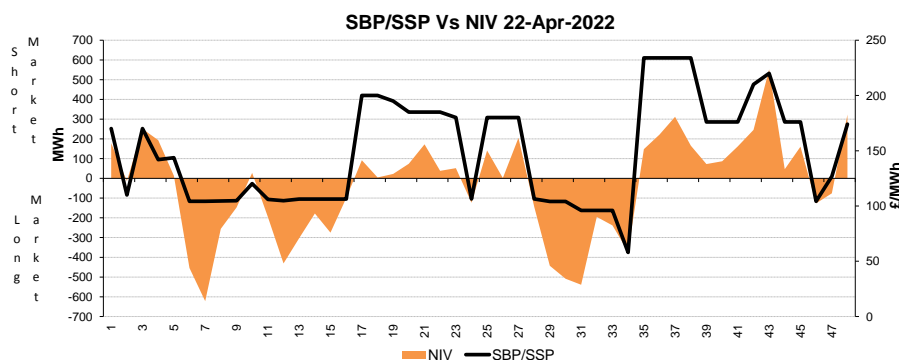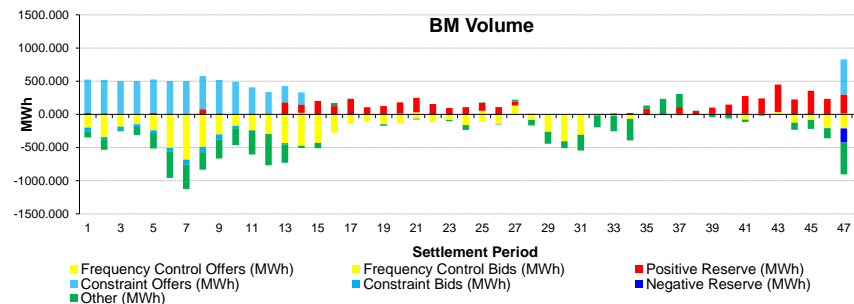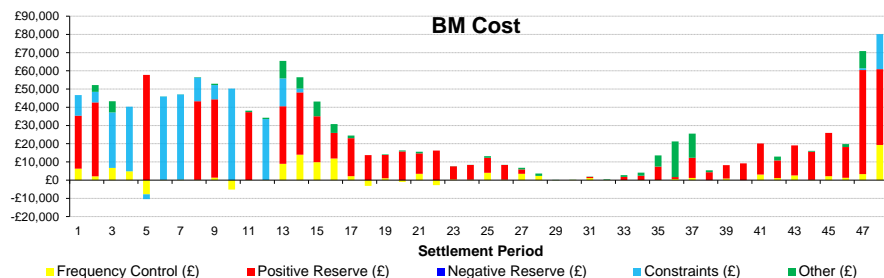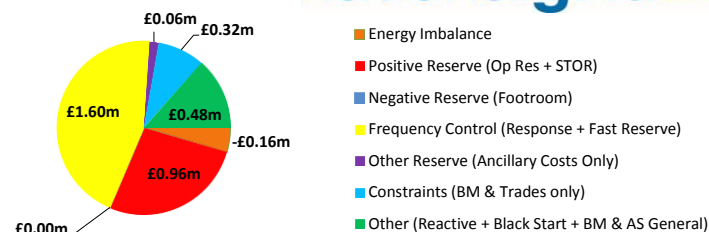

Commentary

A short market over the morning to midday period, and from the late afternoon onwards into the night. Interconnector Trades were required for Downward Regulation overnight and for Margin over the early morning. Overnight Voltage Control supported by Trades and BM Action. BM Action required overnight for System Inertia. BM Action required during the early hours of the day to manage localised thermal export constraints in the North of Scotland.