


Date: Sunday 15 Mar 2020





BSUoS Charge Estimate: £4.97/MWh
Total Outturn: £6.33m

BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

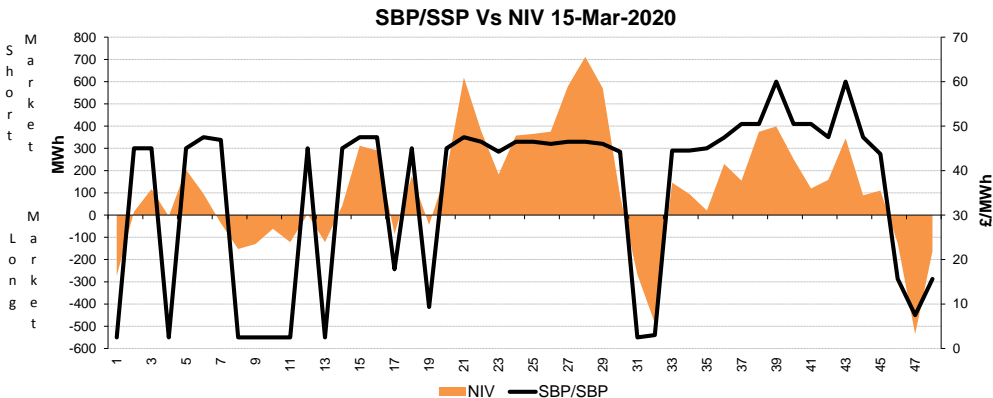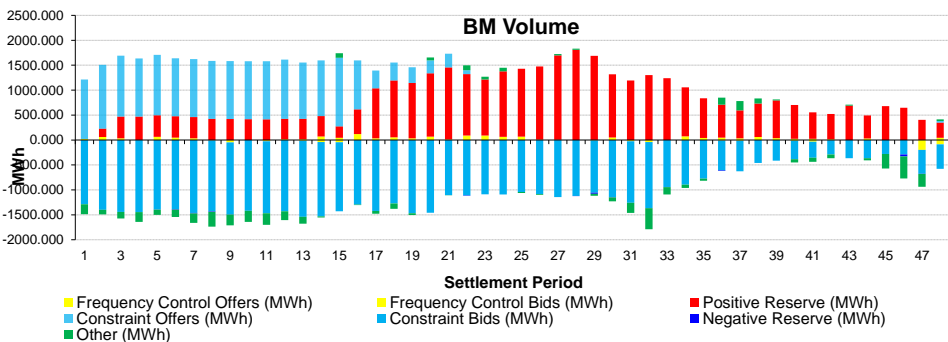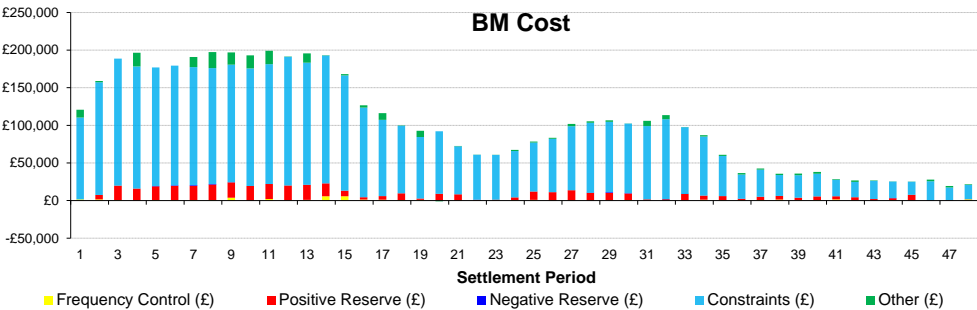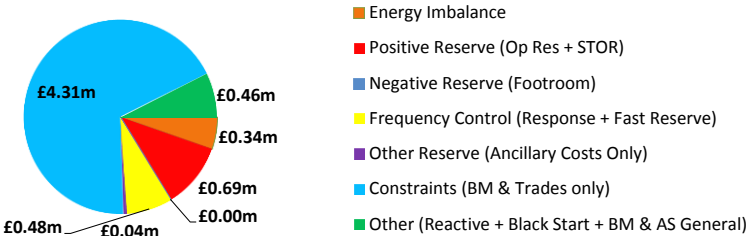

Western Link status: Available

Commentary

The market was short in excess of 1200MW between the morning and the afternoon. Between midnight and the early afternoon a large volume of BM actions were required to solve power flow restrictions in Scotland and on the network boundary between Scotland and England, due to high wind level and planned outages. Multiple trades on the interconnectors and on generating units were undertaken from midnight until the afternoon to mitigate the RoCoF risk. Some additional BM actions were required in the late morning for RoCoF. Overnight the voltage levels in England were managed with a mix of trades and BM actions.