
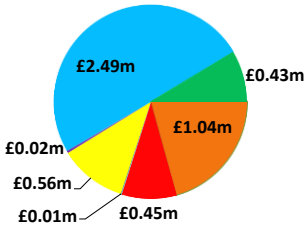


Date: Monday 03 May 2021




BSUoS Charge Estimate: £4.22/MWh  
Total Outturn: £4.99m

Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

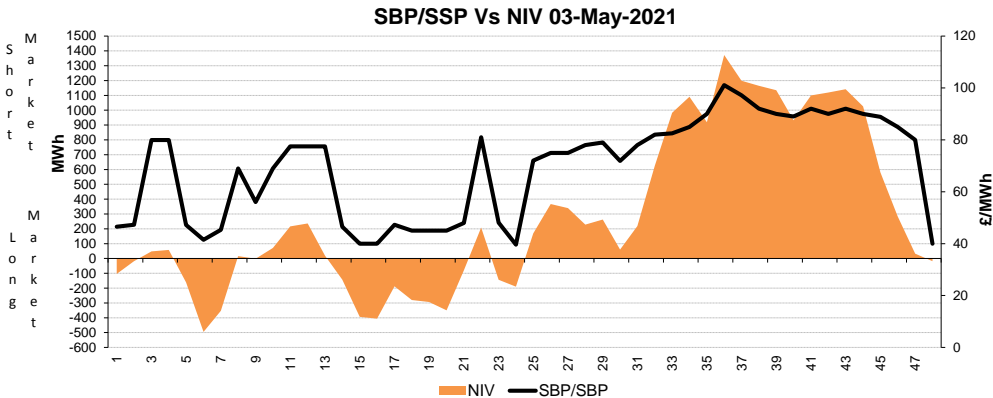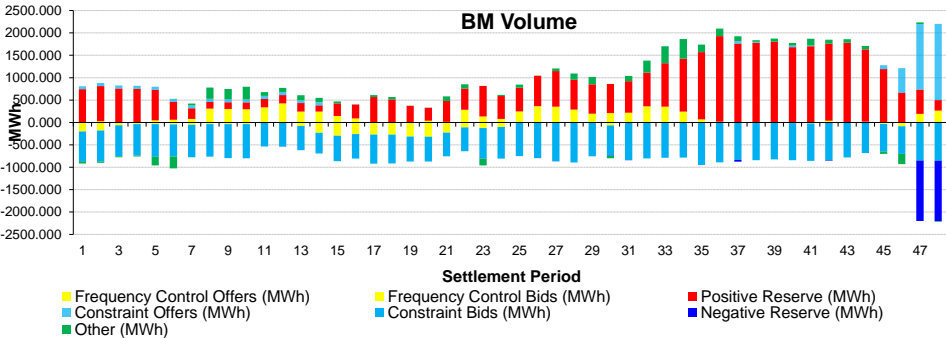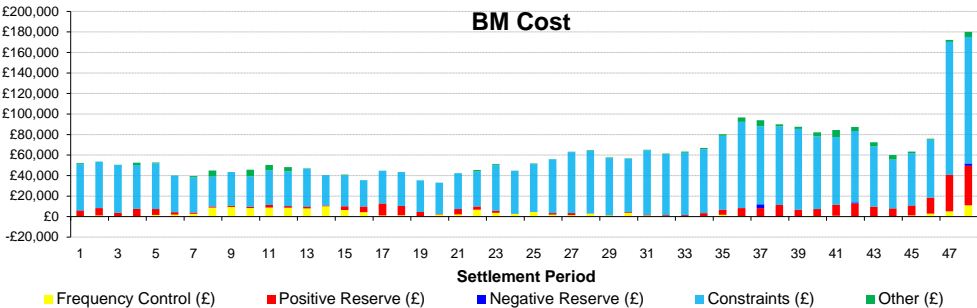

Commentary

The market was mostly short from midday onwards into the night. Interconnector Trades for Downward Regulation required from 11pm at night. Overnight Trades and BM Action for Voltage Control. Trades and BM Action throughout the day for RoCoF.

Western Link status: Available