
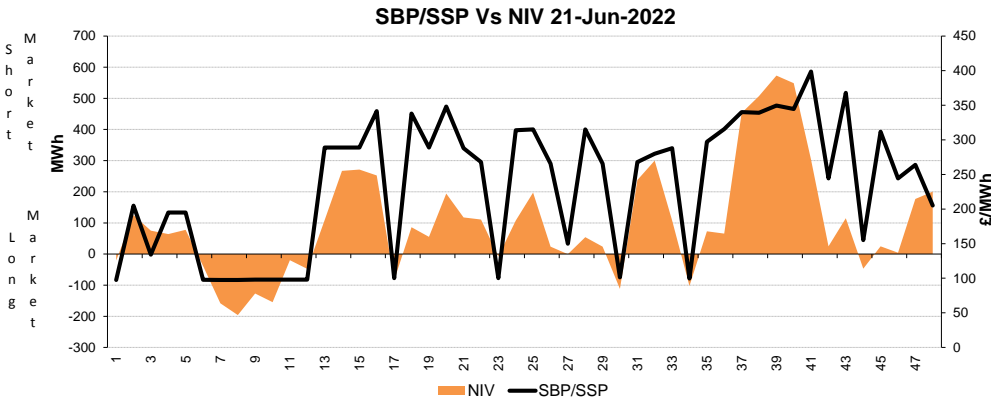
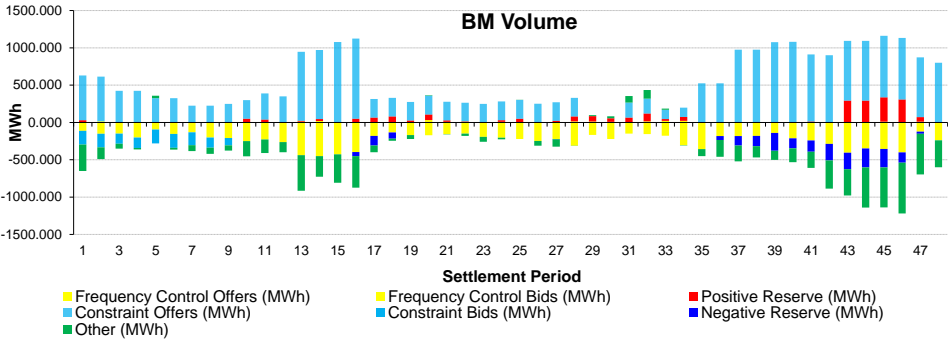
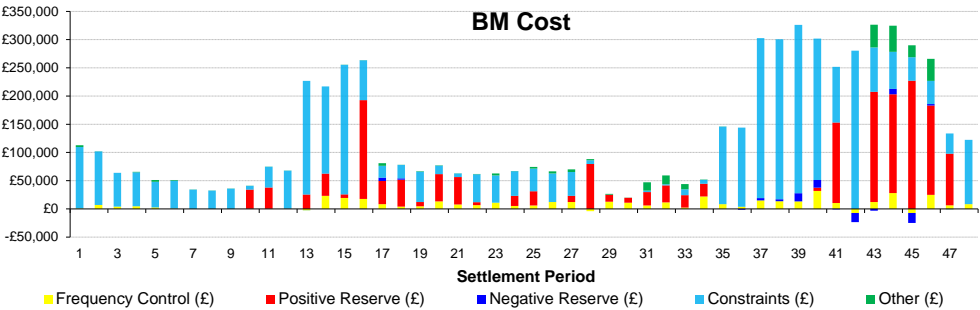
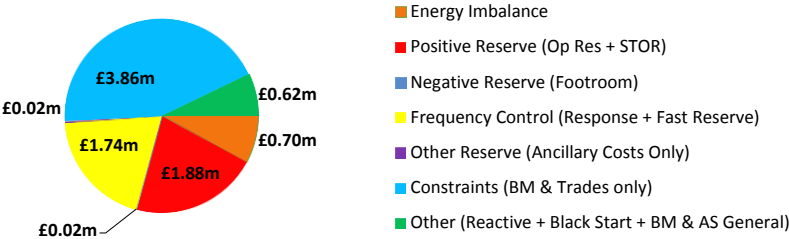


Date: Tuesday 21 Jun 2022

BSUoS Charge Estimate: £8.63/MWh  
Total Outturn: £8.84m

# Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



## Commentary

A mostly short market from the early morning onwards. Interconnector Trades were required for Margin briefly during the morning, and in the evening. Trades throughout the day alleviated thermal import constraints in the South East of England. Some BM Action required during the morning hours for thermal export constraints in Scotland. All overnight Voltage requirements met by the market.