

Date: Thursday 16 Jun 2022

BSUoS Charge Estimate: £5.03/MWh






Total Outturn: £5.15m

Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)

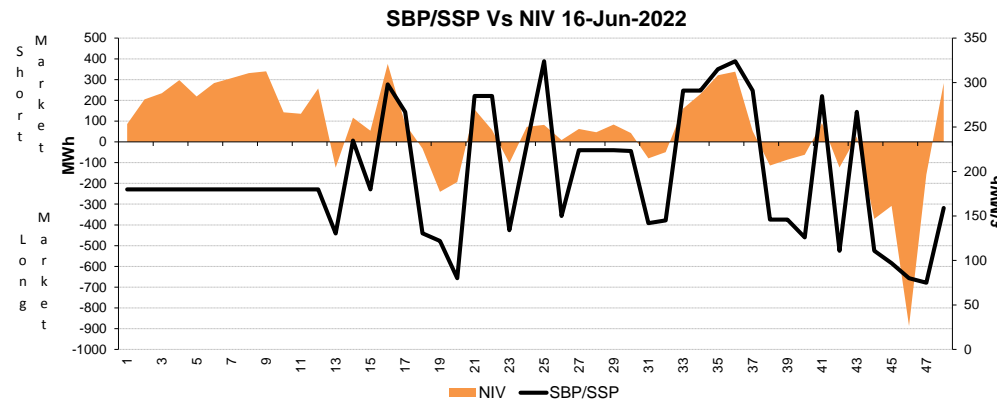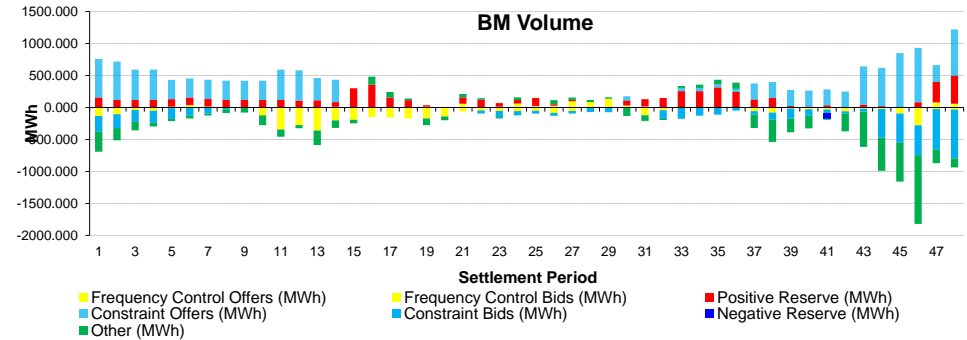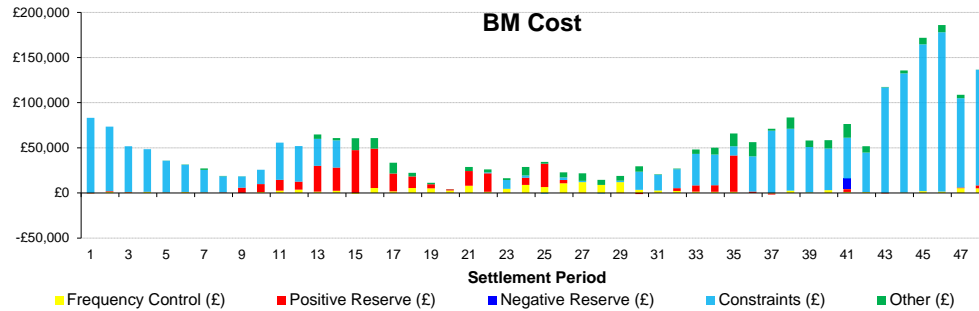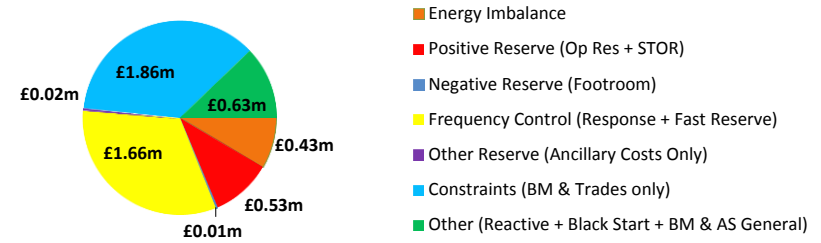

Commentary

A short market through most of the day until the early evening. Interconnector Trades were required for Margin between 6am and 9am in the morning. Trades alleviated thermal import constraints in the South East of England during the morning, afternoon and evening. BM Action managed thermal export constraints in Scotland during the late night and also power flow constraints from the North to South of England. BM Action was required for thermal export constraints in the Wales area during the day. Overnight Voltage Control assisted by BM Action in the South East of England.