

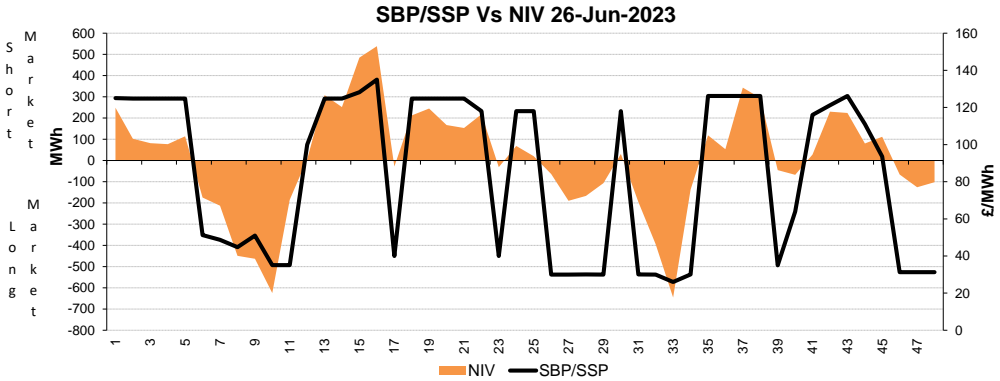
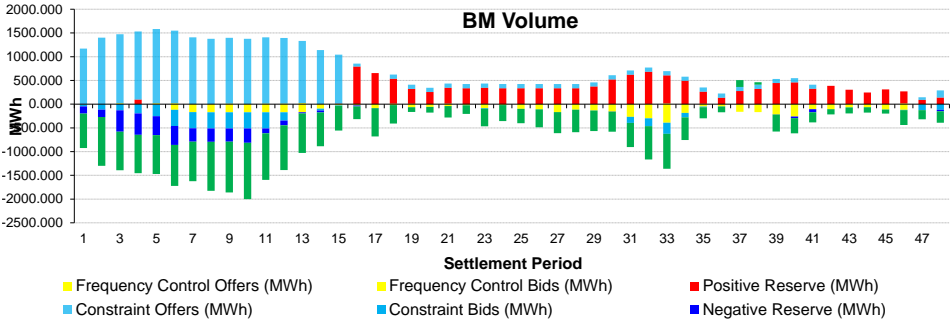
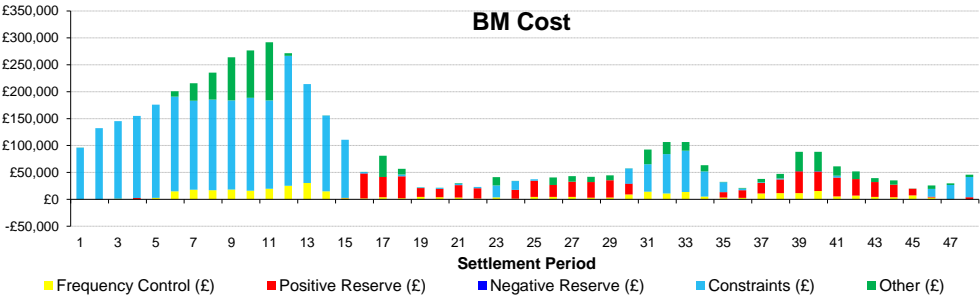


Daily Balancing Costs

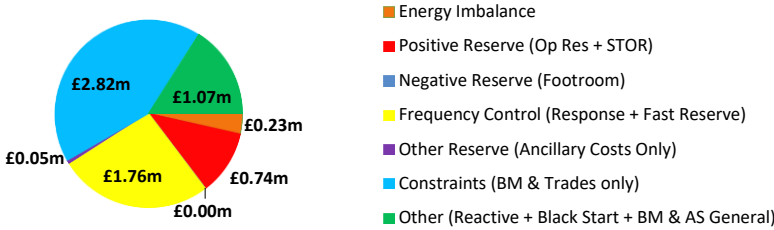

BM Cost (Indicative)

AS Cost (Estimate)



**Commentary**

The market position varied throughout the day. Trades were made for Margin during the early morning and for Downward Regulation in the evening.

Thermal constraints were active in Northern England during the early morning, mid-afternoon and late evening. BM Actions assisted Voltage Management and Inertia.