






Date: Thursday 02 Jul 2020

BSUoS Charge Estimate: £2.19/MWh
Total Outturn: £2.18m

BM Cost (Indicative)
AS Cost (Estimate)



Daily Balancing Costs

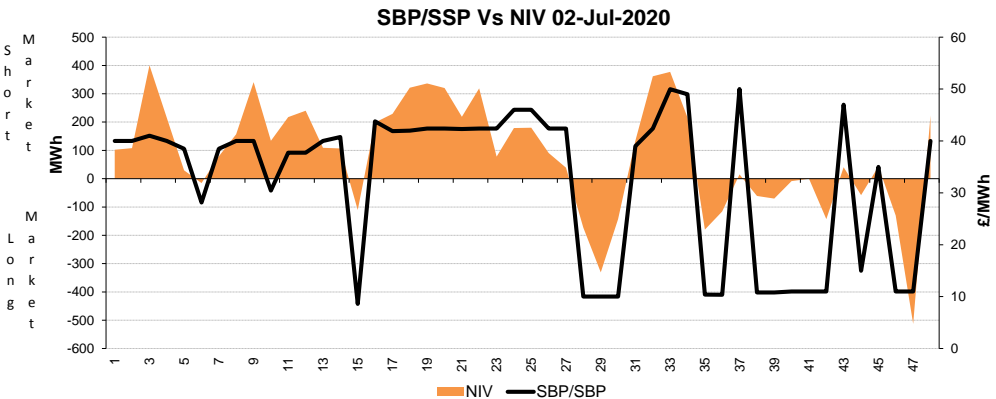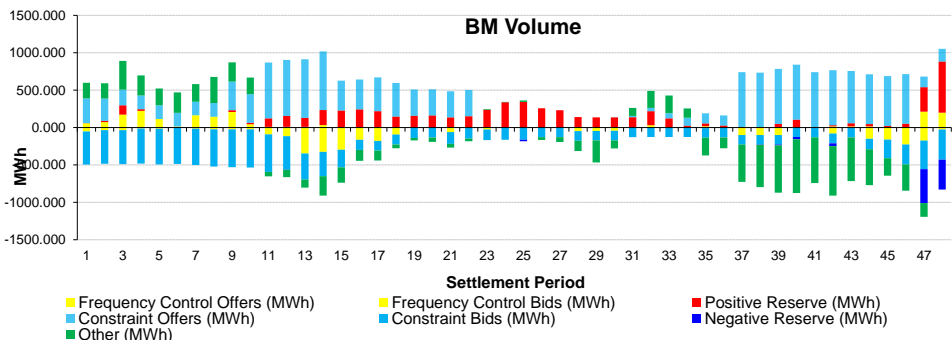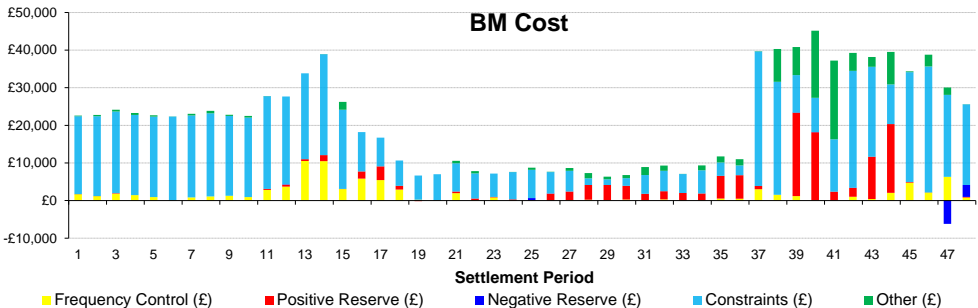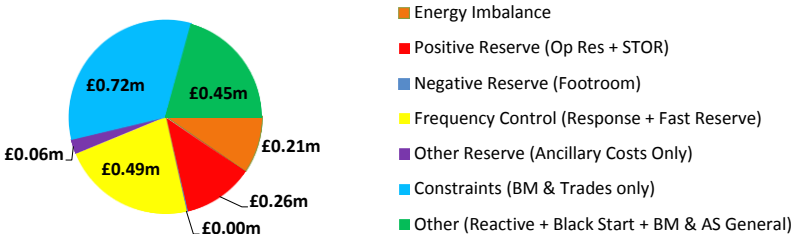

Western Link status: Available

Commentary

The market remained mostly short for the morning and switched to a mostly long position in the mid-afternoon. Trades were made for downwards regulation late evening.

BM Actions were required alleviate thermal constraints in northern Scotland. BM Actions and Interconnector trades were also needed in the south east of England for constraint purposes. Overnight trades were carried out for RoCoF and voltage management.