

Date: **Tuesday 07 Jul 2020**






BSUoS Charge Estimate: £2.02/MWh

Total Outturn: £2.02m

# Daily Balancing Costs

BM Cost (Indicative)

AS Cost (Estimate)

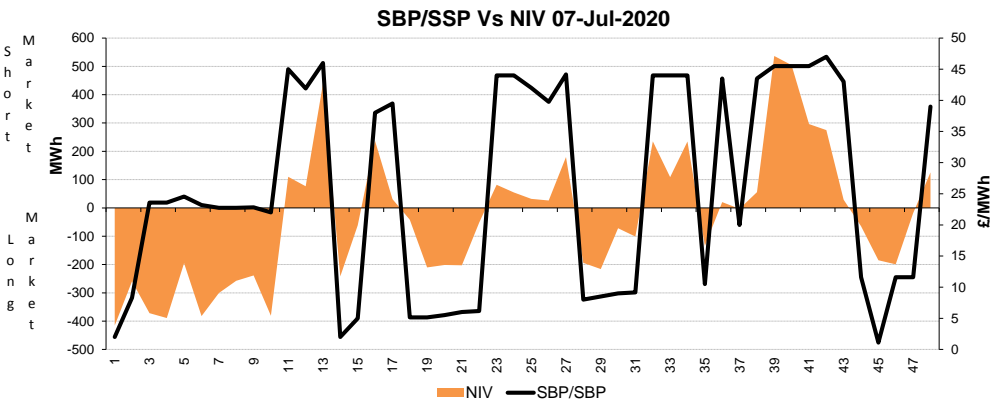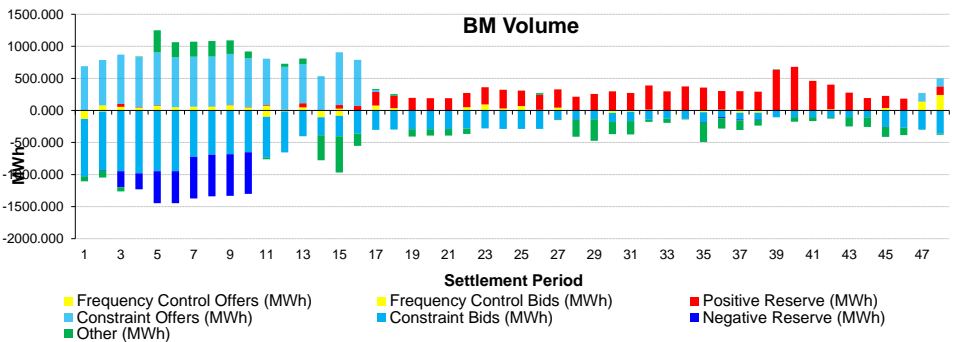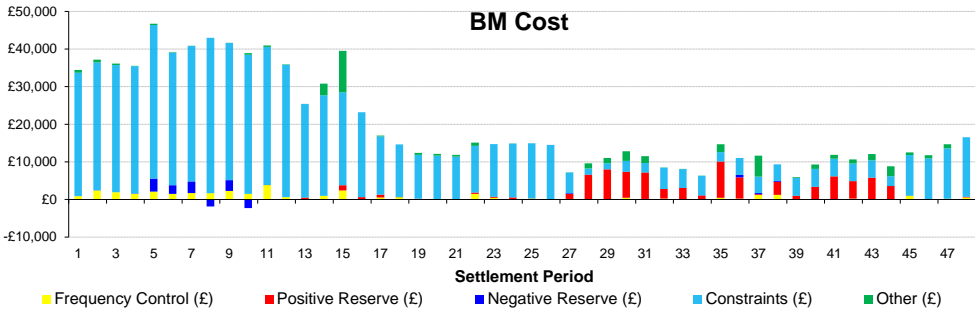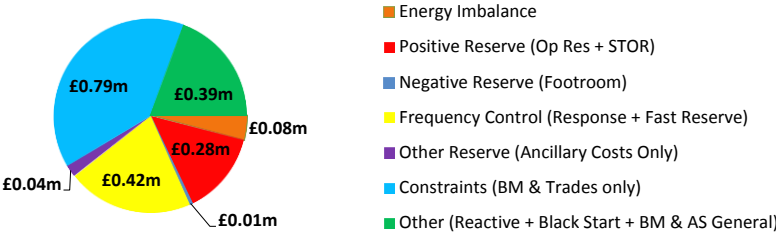

**Western Link status: Available**

## Commentary

A long market overnight, becoming alternately short and long throughout the day from early morning onwards. Interconnector Trades were required for Margin between 7pm and 8pm. Overnight Voltage Control supported by Trades in the Midlands and Greater London area, and by BM Actions in Wales, the South and South East. Trading throughout the day assisted with RoCoF, with some BM Actions alongside. Interconnector Trading helped alleviate thermal import constraints in the South East between 7am and 8am. Some BM Action was required morning onwards to manage localised thermal export constraints in the North of Scotland.