

Date:


Tuesday 27 Jul 2021

BSUoS Charge Estimate: £4.10/MWh

Total Outturn: £4.29m


BM Cost (Indicative)

AS Cost (Estimate)






Daily Balancing Costs

nationalgridESO



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

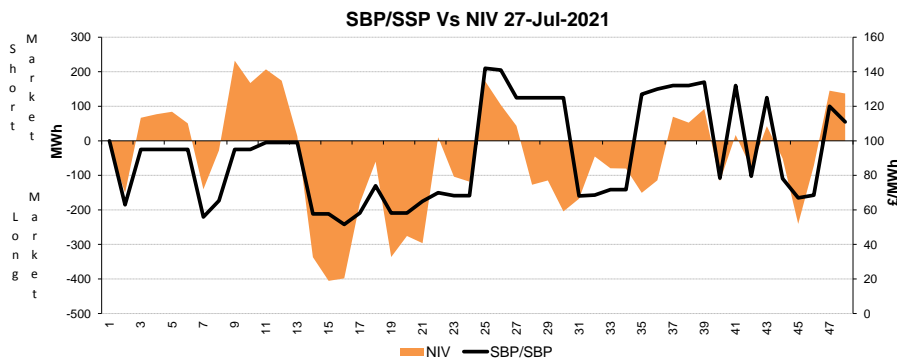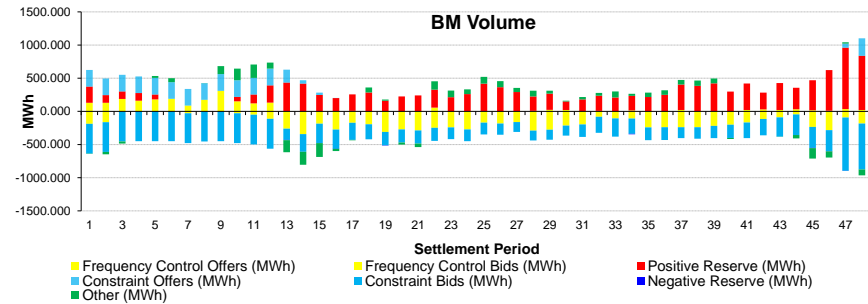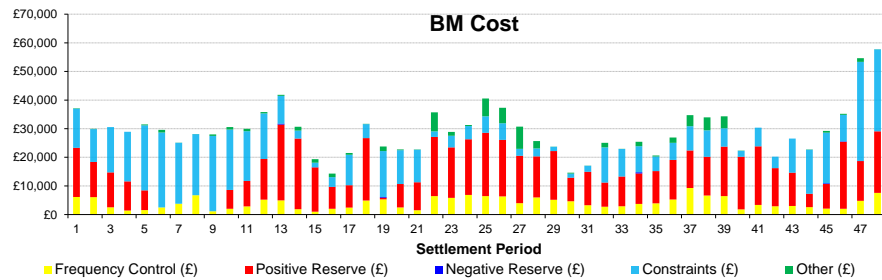

Commentary

The market position alternated through the day. Wind generated above forecast in the evening and overnight.

Constraints were active in the south of England for most of the day. Trades and BM Actions were made for RoCoF. An optional contract, trades and BM Actions were used for voltage management.

Western Link status: Available