


Date: Sunday 03 Jul 2022

BSUoS Charge Estimate: £7.53/MWh

Total Outturn: £6.57m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

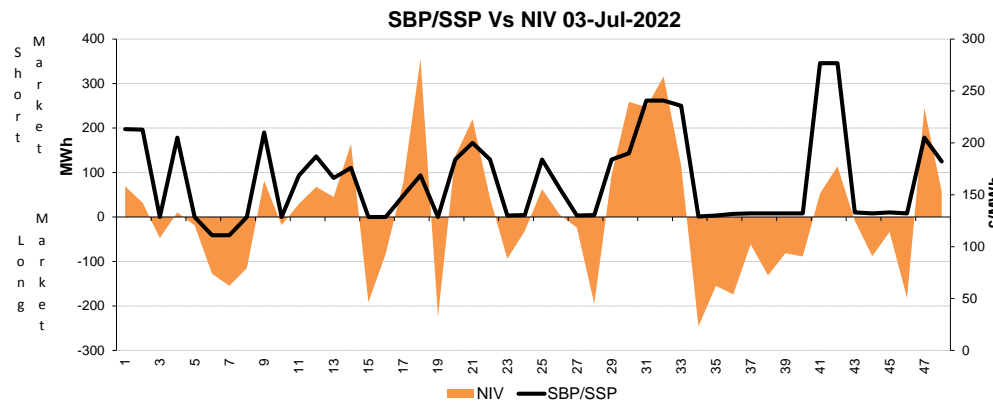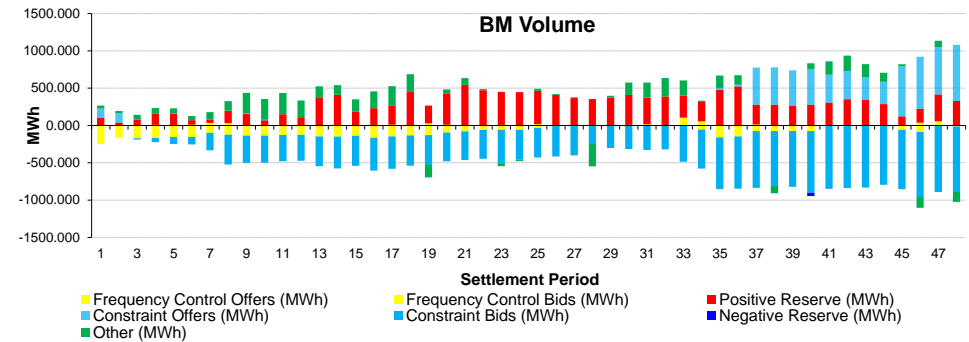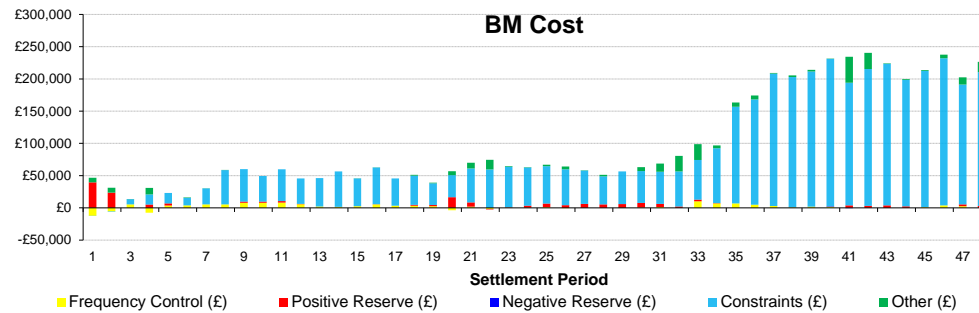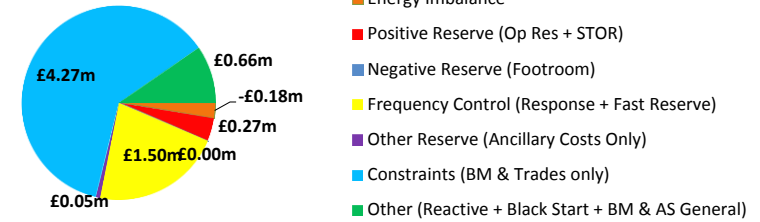

Commentary

A long and short market intermittently through the day. Interconnector Trades were required for Margin during the morning and late afternoon, and for Response throughout the day. 260MW of Non-BM Fast Reserve was run over 6am in the morning.

Trades alleviated power flow constraints from the North to South of England in the early hours at the start of the day, and for thermal import constraints in the South East of England from 5pm onwards. BM Action was required for thermal export constraints Scotland in the morning and afternoon to evening. All overnight Voltage requirements met by the market.