



Date: Saturday 29 Aug 2020




BSUoS Charge Estimate: £5.54/MWh
Total Outturn: £5.50m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Energy Imbalance
Positive Reserve (Op Res + STOR)
Negative Reserve (Footroom)
Frequency Control (Response + Fast Reserve)
Other Reserve (Ancillary Costs Only)
Constraints (BM & Trades only)
Other (Reactive + Black Start + BM & AS General)

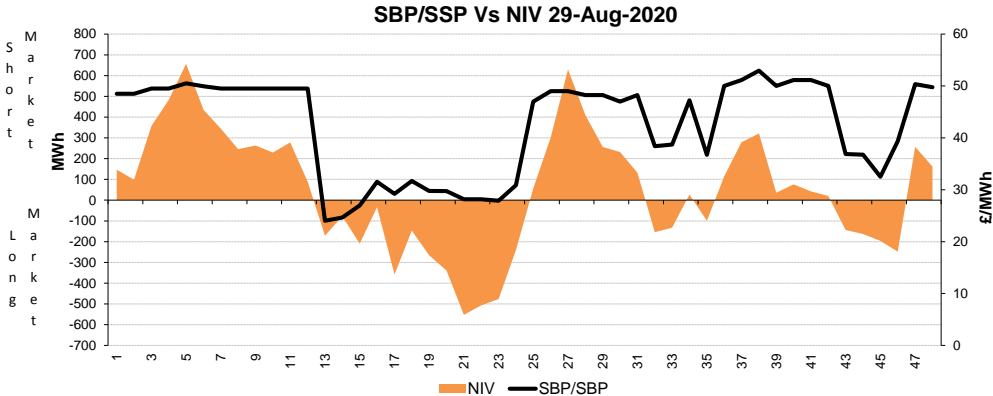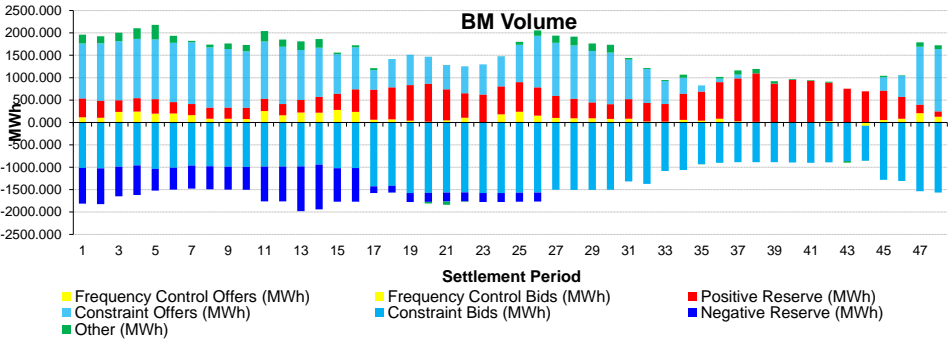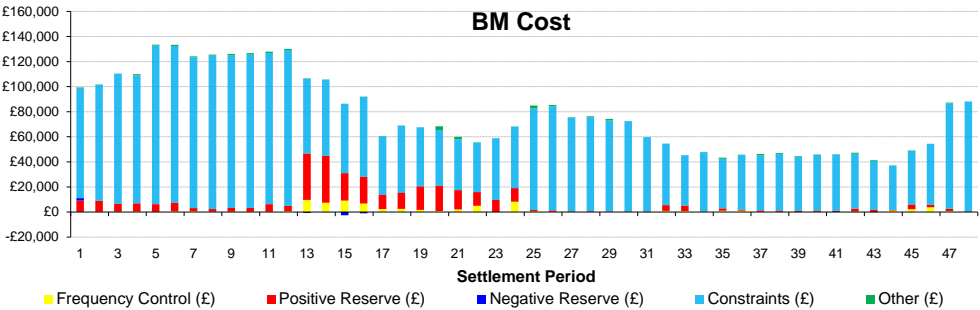

Commentary

The market was short overnight, and mostly short from midday onwards. Interconnector Trades overnight to midday for Downwards Regulation. Overnight Trades and BM Actions for Voltage Control. Interconnector Trades and BM Action throughout the day for RoCoF.

Western Link status: Available