
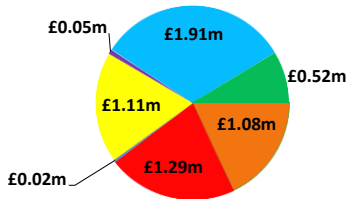


Date: Sunday 15 Aug 2021




BSUoS Charge Estimate: £7.26/MWh  
Total Outturn: £6.96m

Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

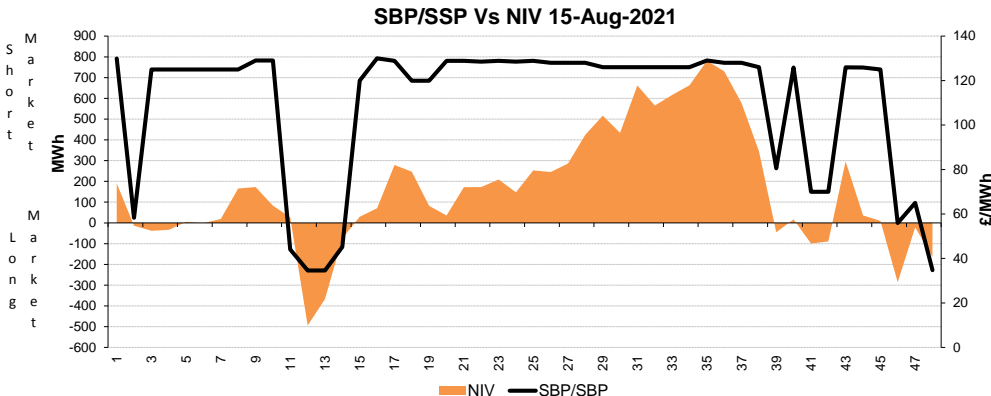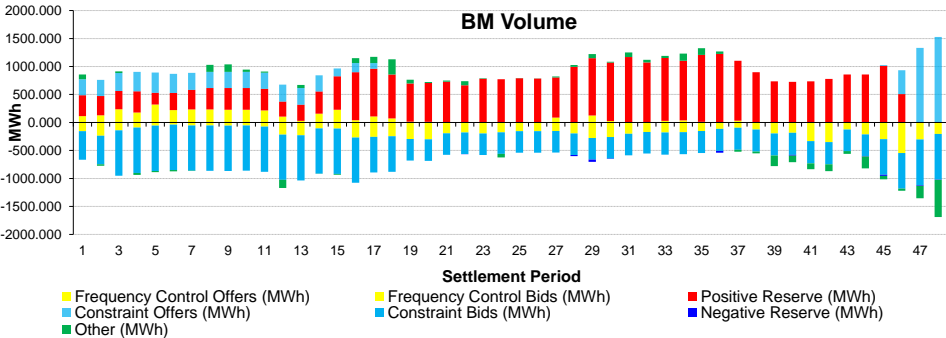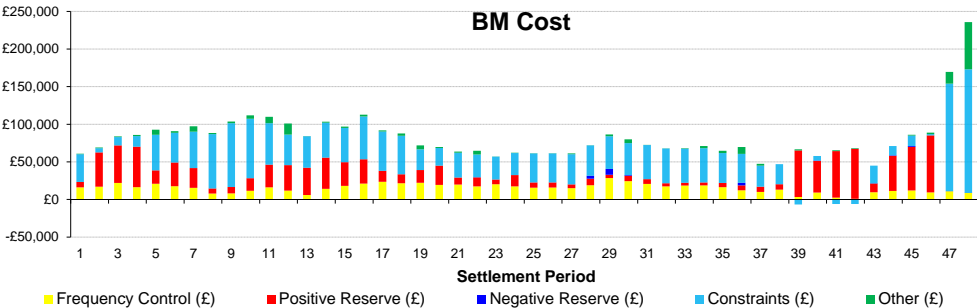

Commentary

The market was mostly short through the day. Demand was higher than forecasted in the daytime and trades were made for margin.

Overnight interconnector trades were made for RoCoF. A combination of an optional contract, trades and BM actions were required for voltage management.