






Date: Friday 13 Aug 2021

BSUoS Charge Estimate: £6.47/MWh
Total Outturn: £6.44m

Daily Balancing Costs

BM Cost (Indicative)

AS Cost (Estimate)

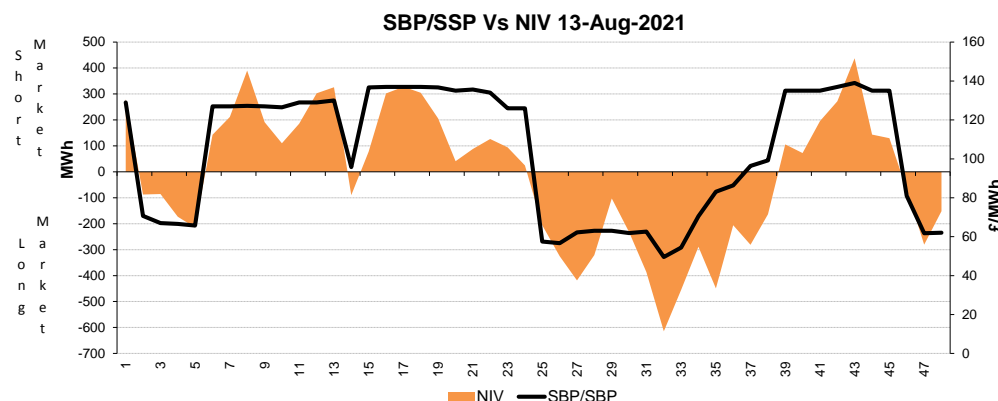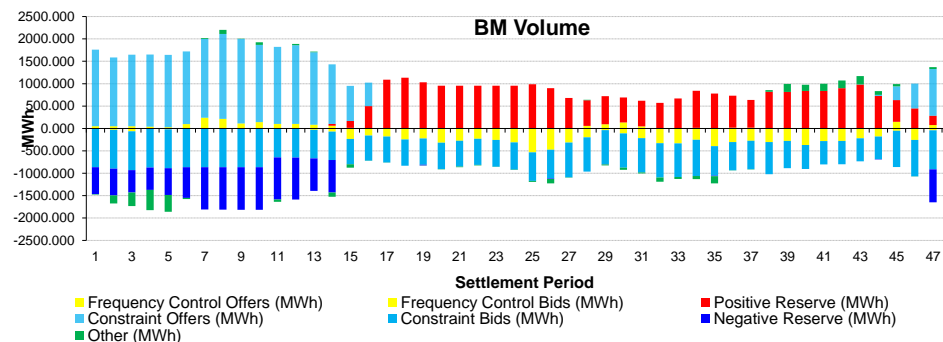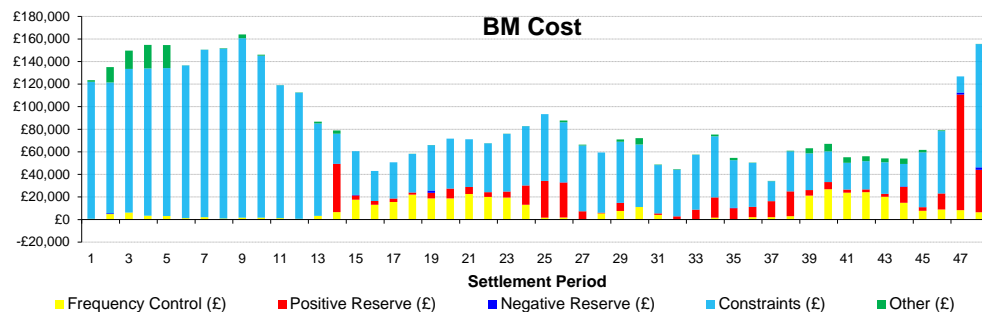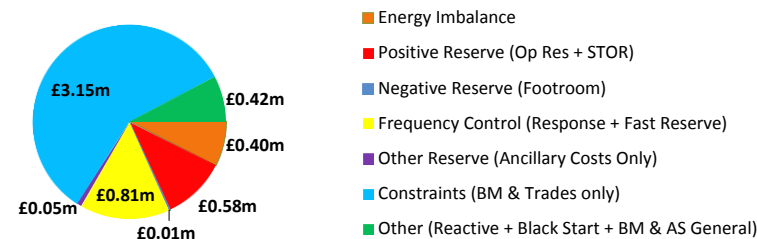

Commentary

The market position changed through the day. Wind generated above forecast during the morning and reduced during the afternoon.

Thermal constraints were active in Scotland and the English border. Significant interconnector trading was required for RoCoF. Trades and BM Actions were used for voltage control.