
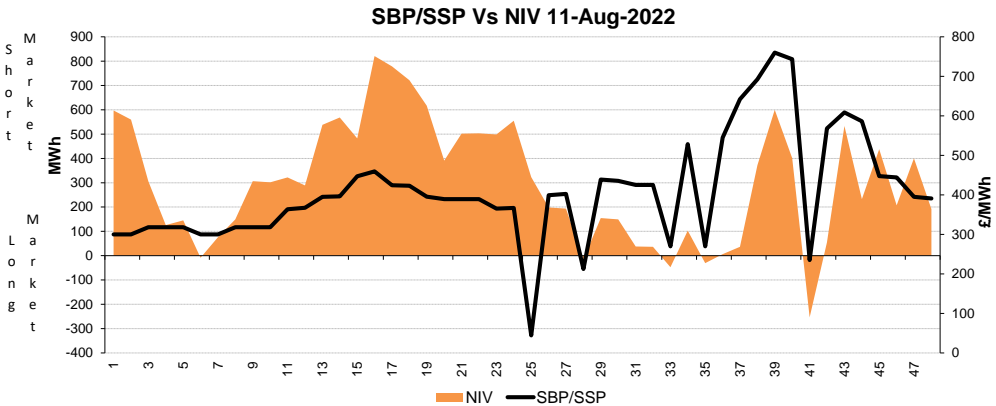
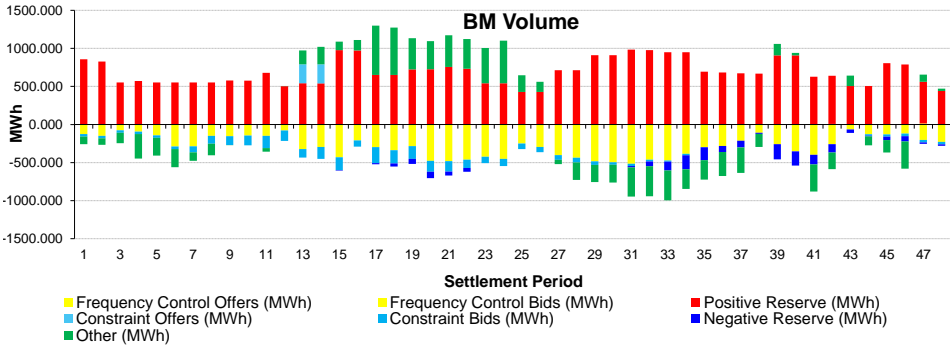
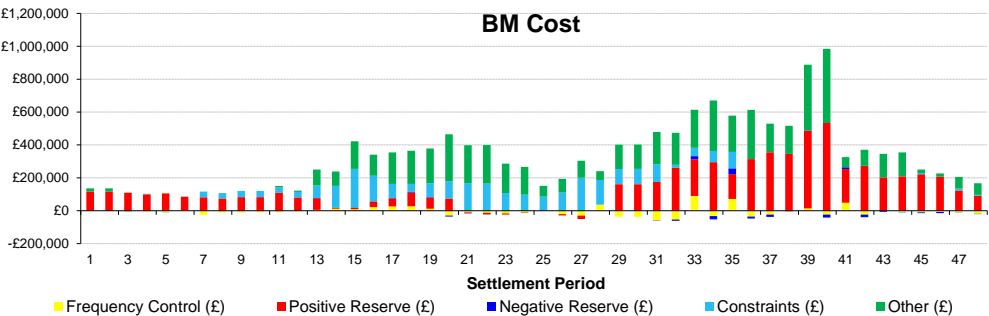
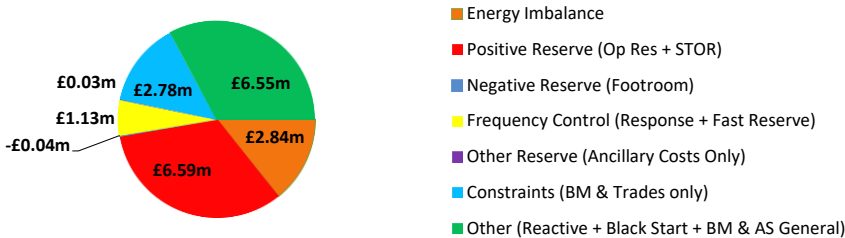


Date: Thursday 11 Aug 2022

BSUoS Charge Estimate: £17.58/MWh
Total Outturn: £19.88m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

A predominantly short market. Interconnector Trades were required for Margin throughout the day. Solar PV generation outturned lower than forecast around midday. Trades alleviated thermal import constraints in the South East of England between 6am and 7am in the morning. BM Action managed localised thermal export constraints in the North of Scotland during the day, and Scotland in the morning. BM Action were required for System Inertia during the morning to midday period. All overnight Voltage requirements met by the market.