


Date: **Wednesday 02 Sep 2020**

BSUoS Charge Estimate: £6.01/MWh


Total Outturn: £7.15m

BM Cost (Indicative)




AS Cost (Estimate)



Daily Balancing Costs



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

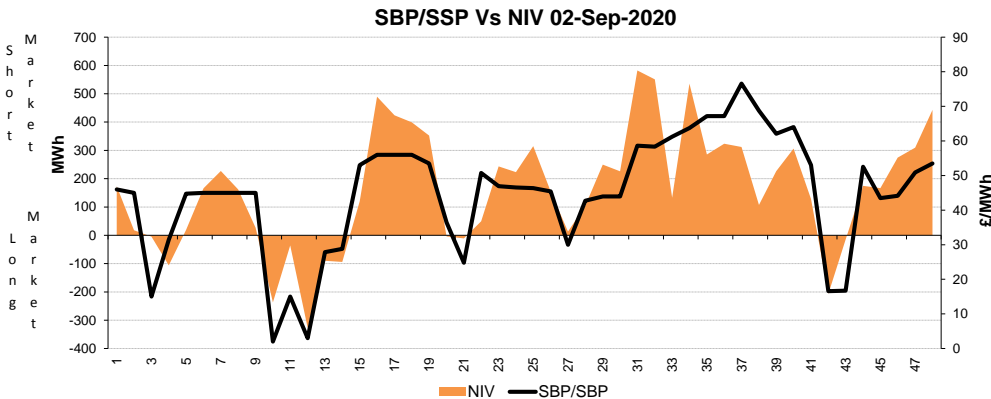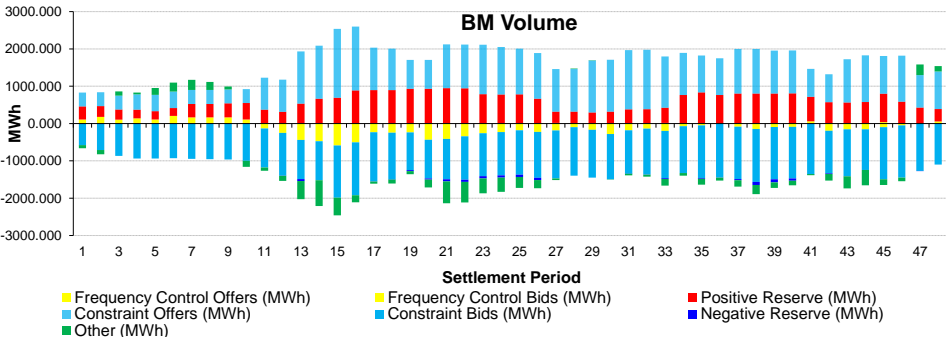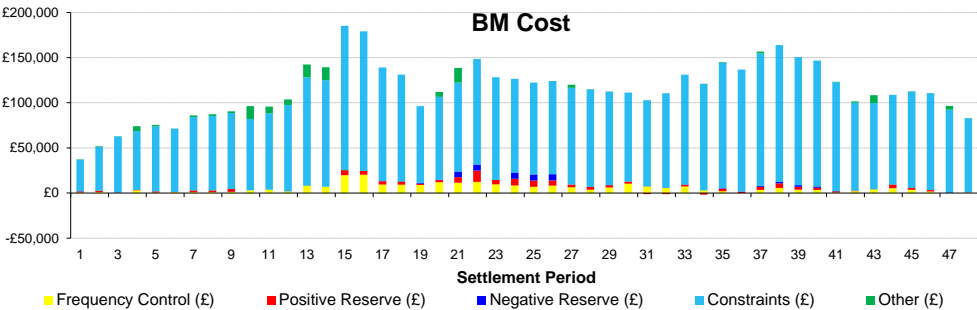

Western Link status: Available

Commentary

The market was mostly short after 7:00am. Small BMUs were used and trades were made for margin. Pump storage was also required.

Constraints were active across Scotland throughout the day with high winds in the north. Trades and BM Actions were needed for RoCoF. Trades and BM Actions were also required for voltage management.