


Date: Thursday 27 Oct 2022

BSUoS Charge Estimate: £8.77/MWh

Total Outturn: £10.31m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

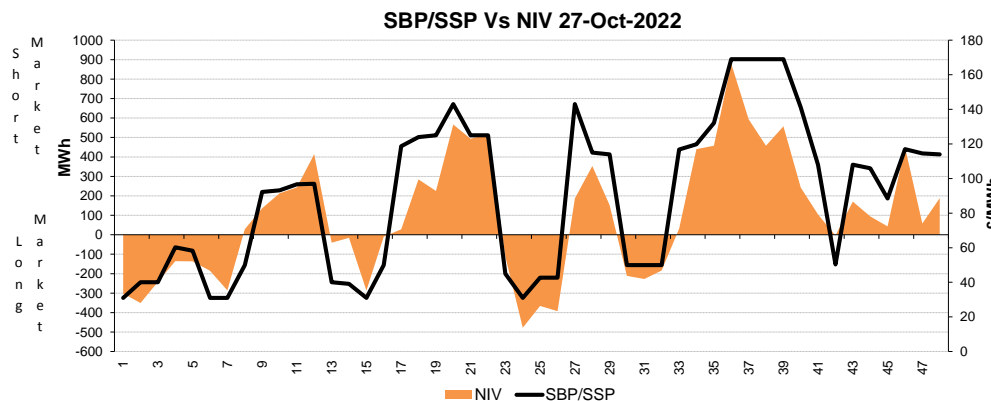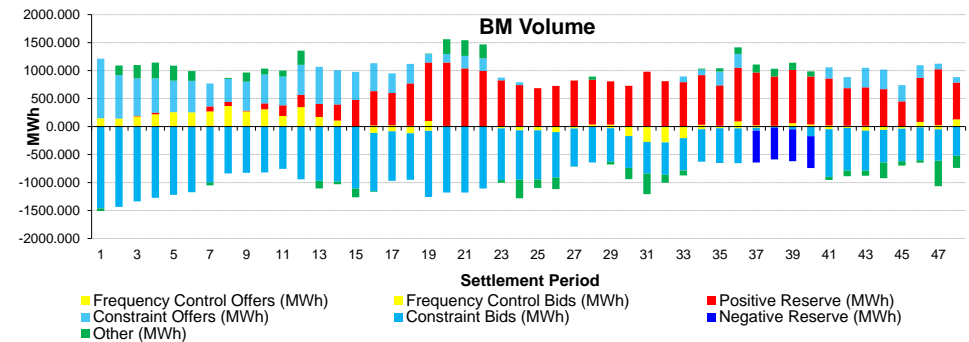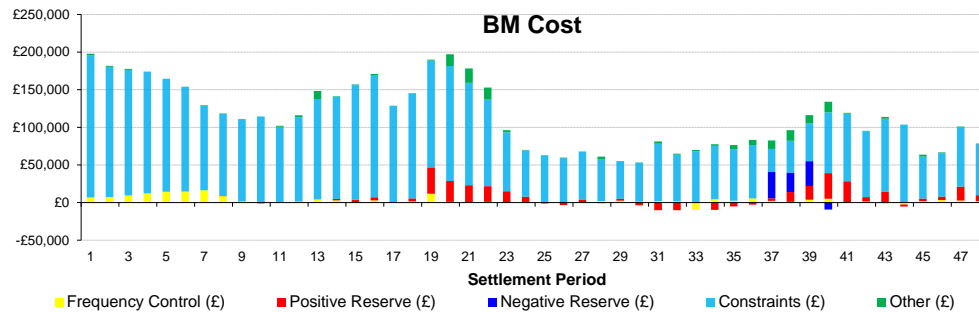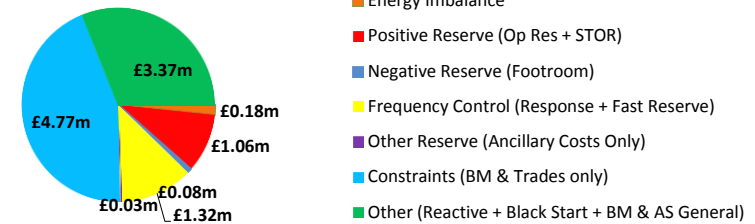

Commentary

The market position started long and was changeable through the rest of the day. 250MW of STOR was run in the evening. Trades were made for margin during the afternoon and evening.

BM Actions and Trades managed thermal import constraints in the South East of England. BM Actions managed thermal export constraints in Scotland. BM Actions assisted with System Inertia. BM Actions and Trades were required for Voltage Control.