
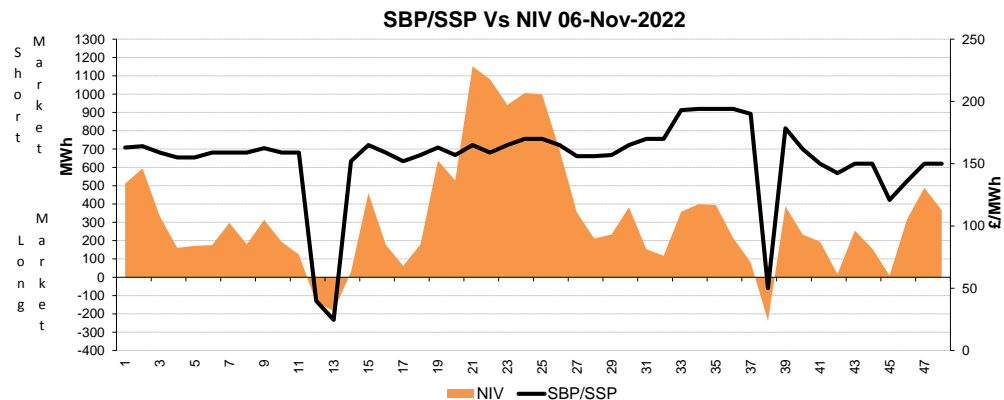
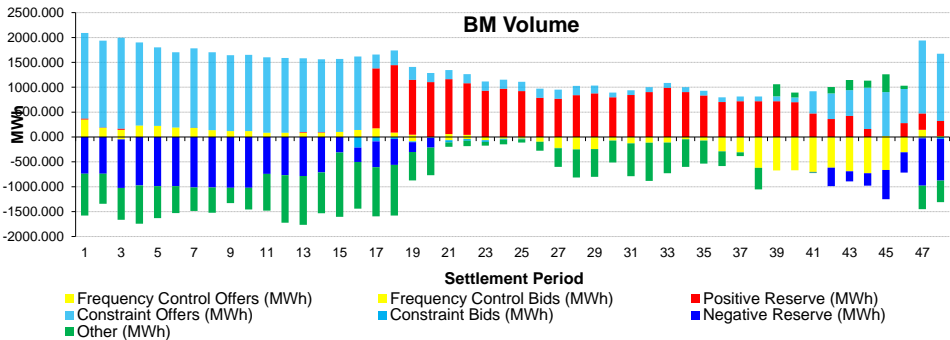
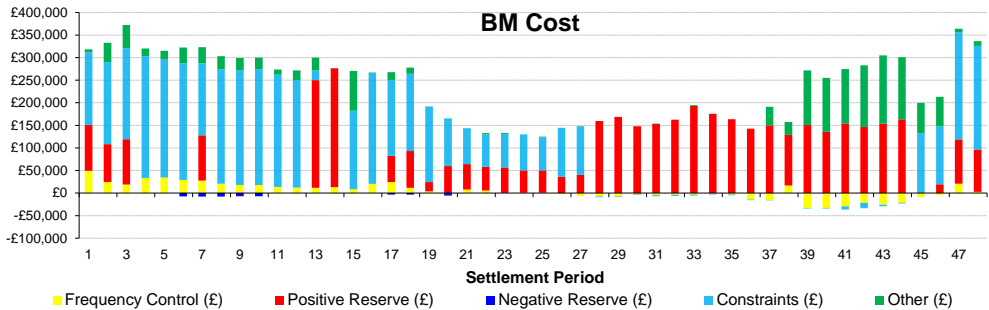
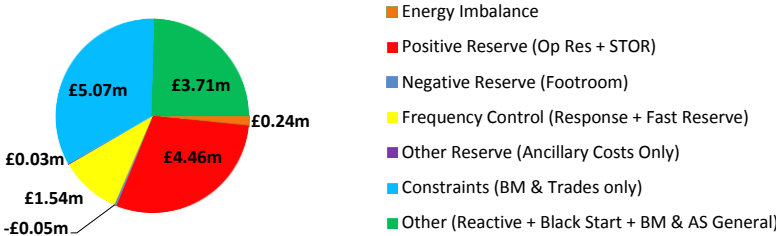


Date: Sunday 06 Nov 2022
BSUoS Charge Estimate: £13.17/MWh
Total Outturn: £15.02m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

The market was short for the majority of the day. Trades were made for downwards regulation throughout the day. Some trades were required for margin between 8pm and 10pm.

Some constraints became active in Scotland and Northern England during the morning and late evening. Trades and BM Actions were used for voltage management. BM Actions also assisted inertia.