



Date: Thursday 23 Dec 2021

BSUoS Charge Estimate: £4.83/MWh
Total Outturn: £6.87m




Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)
AS Cost (Estimate)



Energy Imbalance
Positive Reserve (Op Res + STOR)
Negative Reserve (Footroom)
Frequency Control (Response + Fast Reserve)
Other Reserve (Ancillary Costs Only)
Constraints (BM & Trades only)
Other (Reactive + Black Start + BM & AS General)

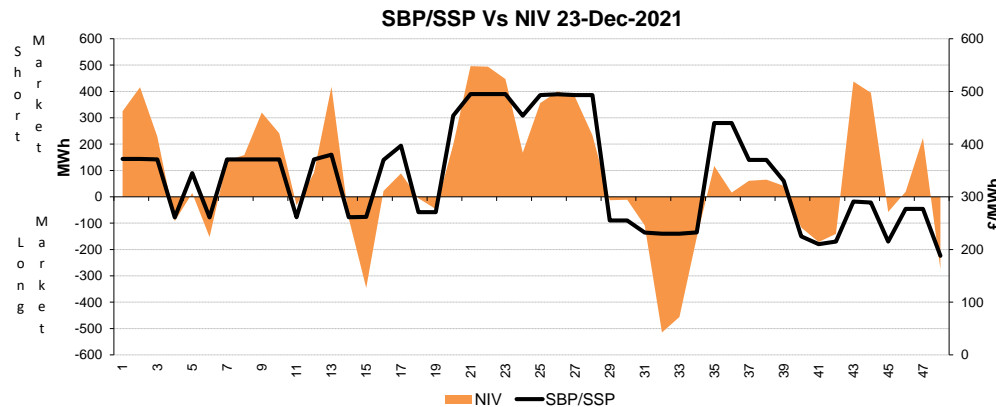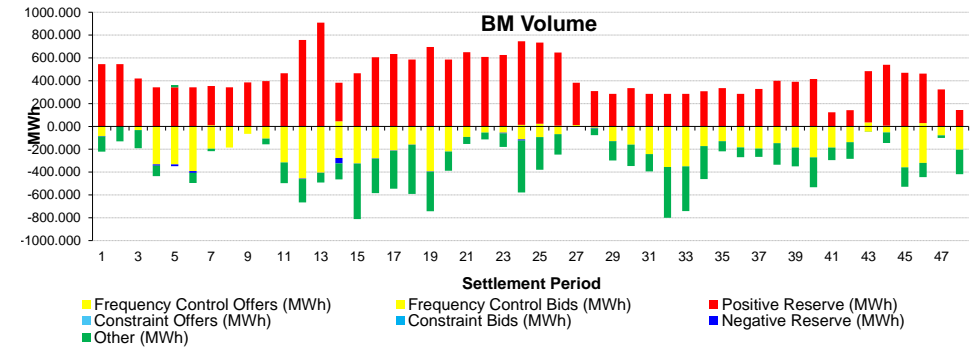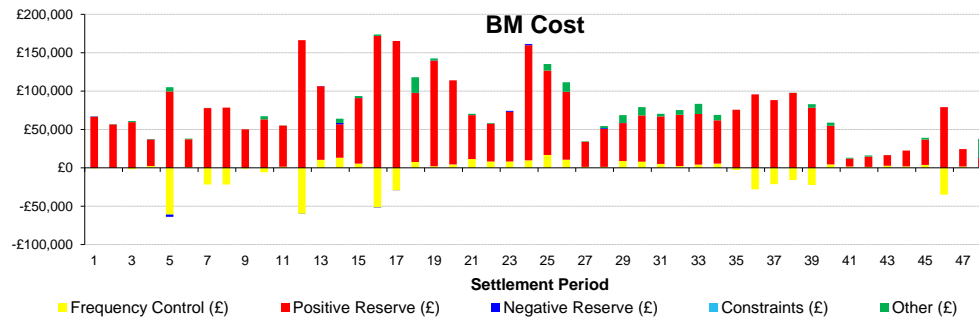

Commentary

A mostly short market overnight into midday.
No active constraints during the day. Voltage Control and System Inertia were adequate with no BM intervention required.