

Date:


Tuesday 25 Jan 2022

BSUoS Charge Estimate: £11.08/MWh

Total Outturn: £18.69m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

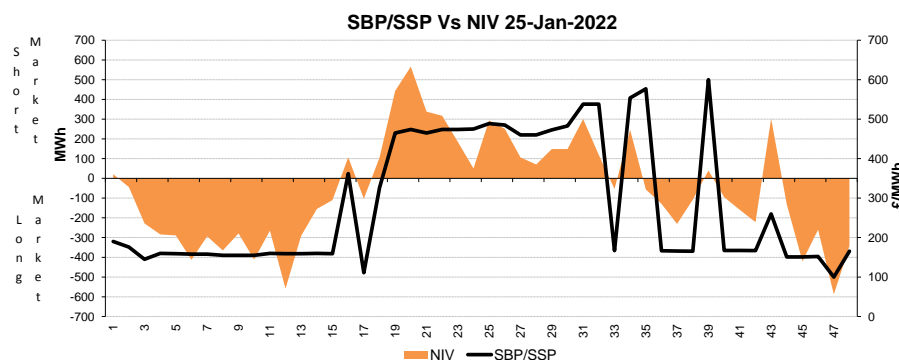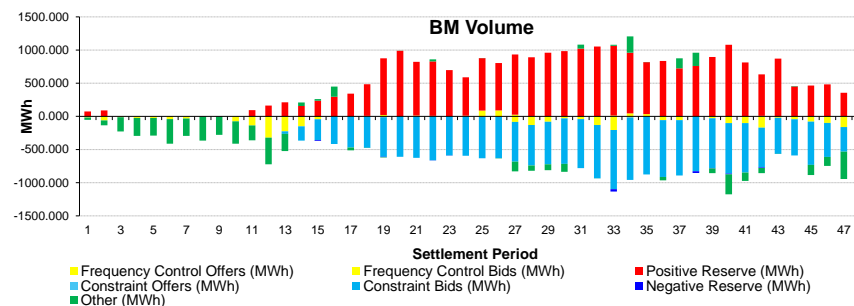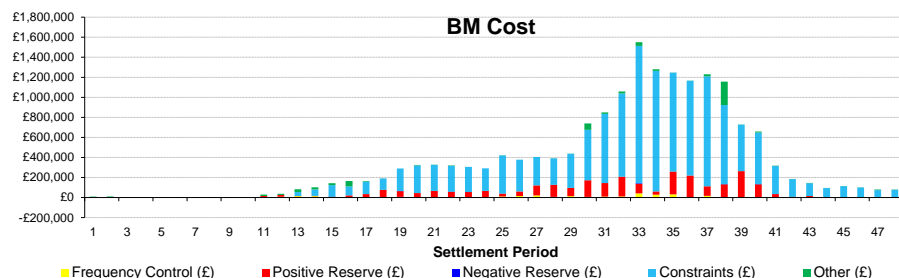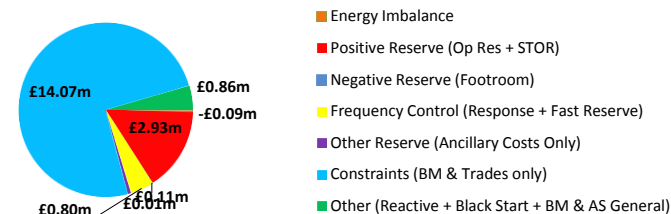

Commentary

The market was short from early morning to the late afternoon. Interconnector Trades were required for Margin during the early hours at the start of the day, between 5am and 8am, and from 3pm to 7pm. Around 138MW of STOR was run over the late morning period. All overnight Voltage requirements met by the market. No action required for System Inertia. BM Action alleviated thermal export constraints in the North of Scotland from morning onwards into the night.