






Date: Thursday 27 Jan 2022

BSUoS Charge Estimate: £6.09/MWh
Total Outturn: £8.76m

BM Cost (Indicative)
AS Cost (Estimate)



Daily Balancing Costs

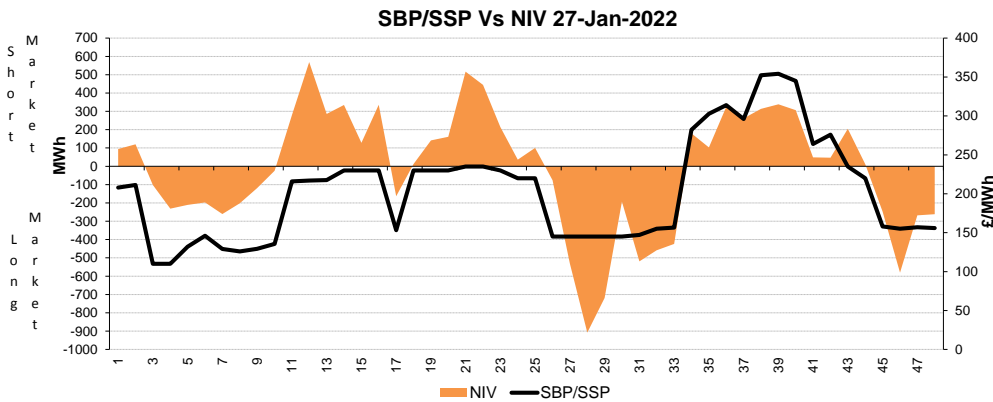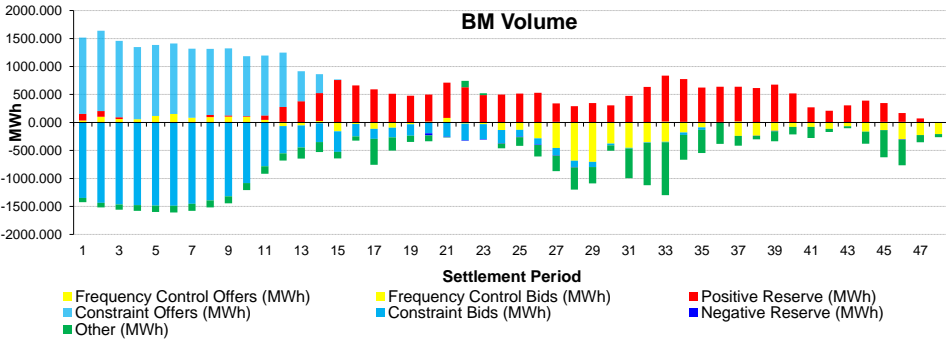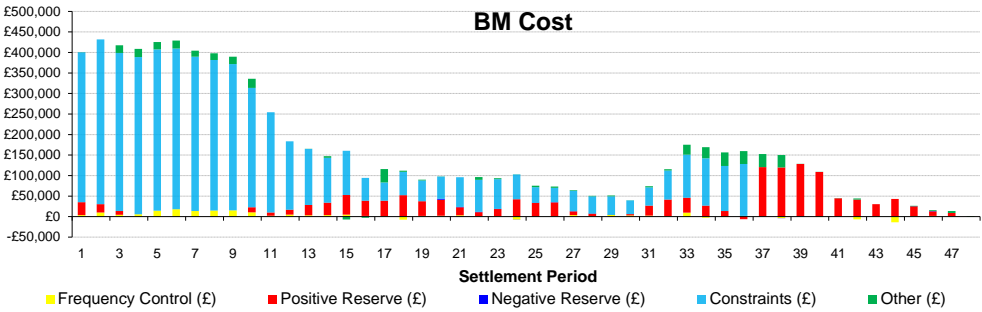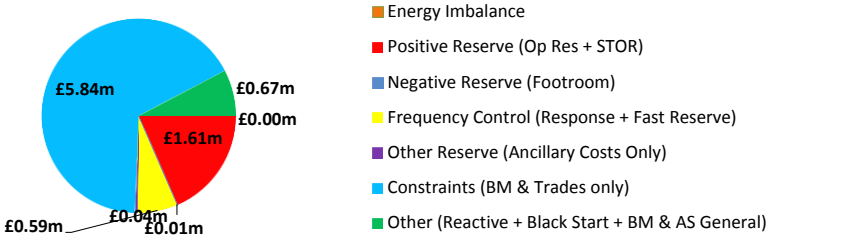

Commentary

A mostly short market over the morning to midday, and from the late afternoon to late evening. Interconnector Trades were required for Margin between 4pm and 7pm. Overnight Trades and BM Action supported Voltage Control in the Midlands, Wales, and South East of England. BM Action was required for System Inertia overnight into the morning at the start of the day. BM Action alleviated thermal export constraints in Scotland and the North of England during the morning, easing by the afternoon.