


Date: Saturday 22 Jan 2022

BSUoS Charge Estimate: £2.35/MWh
Total Outturn: £2.75m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

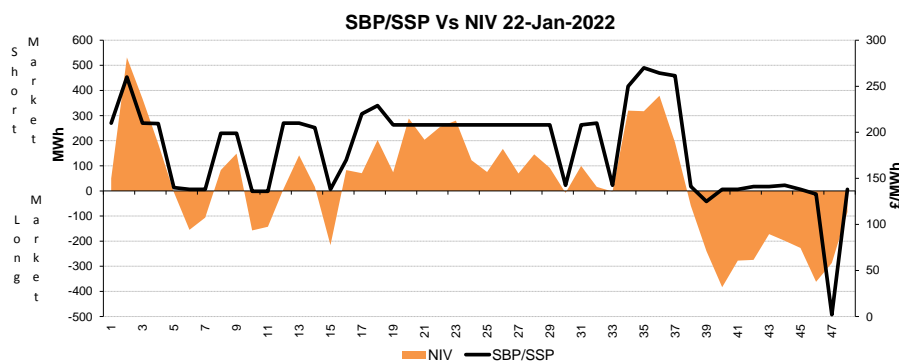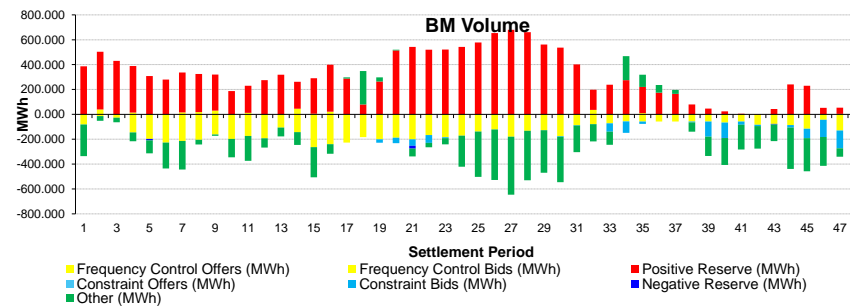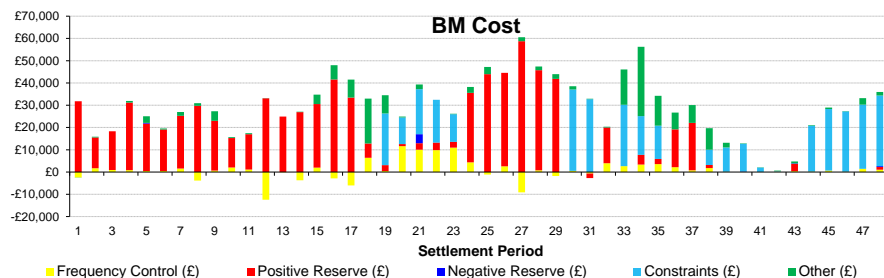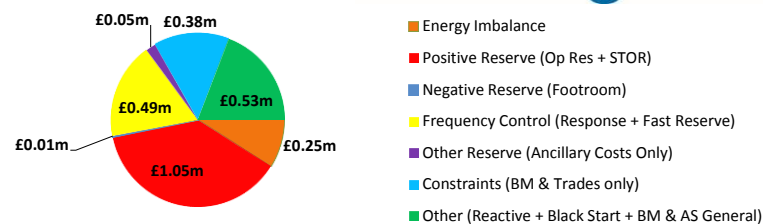

Commentary

A short market overnight and into the day, until the early evening. 400MW of Non-BM Fast Reserve was run over the evening Darkness Peak. Interconnector Trades for Margin were required between 4pm and 5pm in the afternoon.

All overnight Voltage requirements met by the market. No action required for System Inertia. BM Action alleviated thermal export constraints in the North of Scotland during the late morning period, late afternoon, and in the evening.