

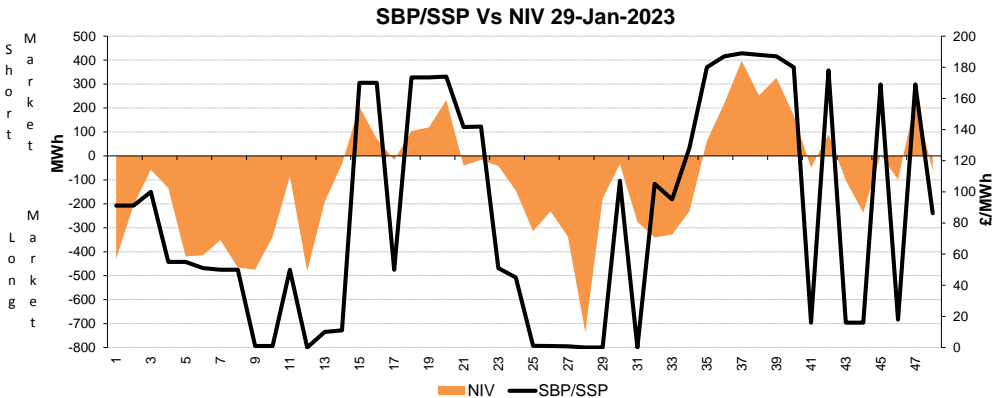
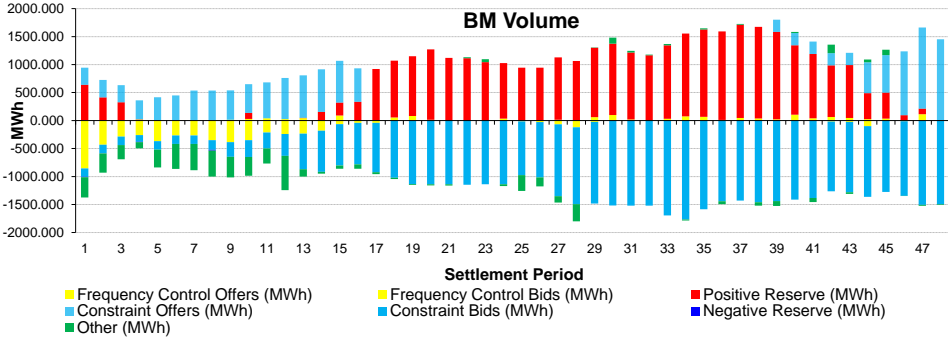
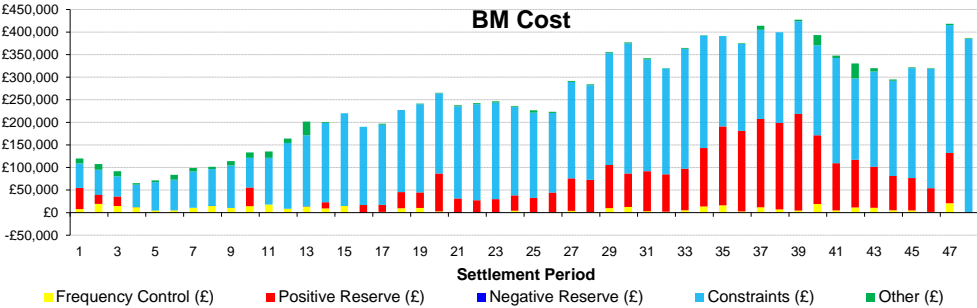


Daily Balancing Costs

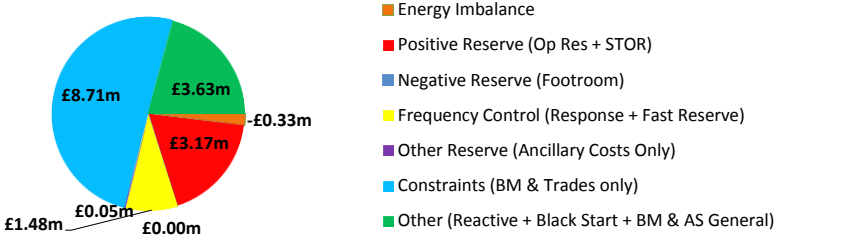

BM Cost (Indicative)

AS Cost (Estimate)



Commentary

The market was long overnight to the early morning, and during the late morning to late afternoon period. 240MW of Non-BM Fast Reserve was run over the Darkness Peak. Trades overnight supported Voltage Control in the Wales area. BM Action also supported overnight Voltage Control in the North East and Midlands areas. BM Action assisted with System Inertia overnight. From morning onwards BM Action alleviated thermal export constraints in the North of England and Scotland.