

Date:


Sunday 27 Feb 2022

BSUoS Charge Estimate: £11.94/MWh

Total Outturn: £13.92m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

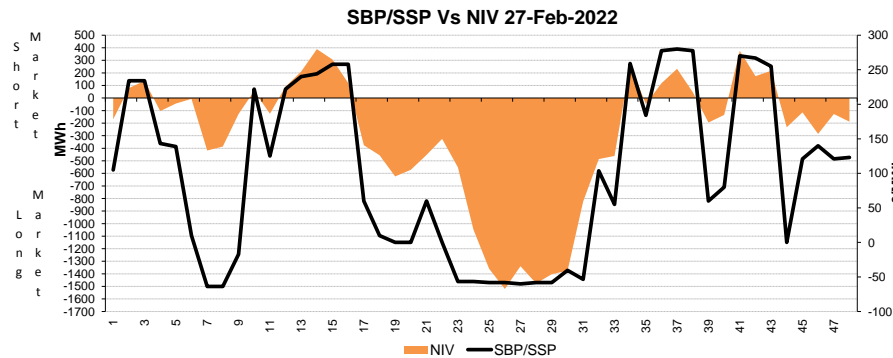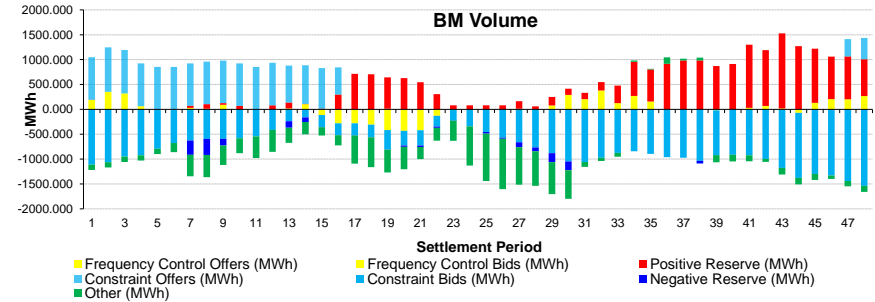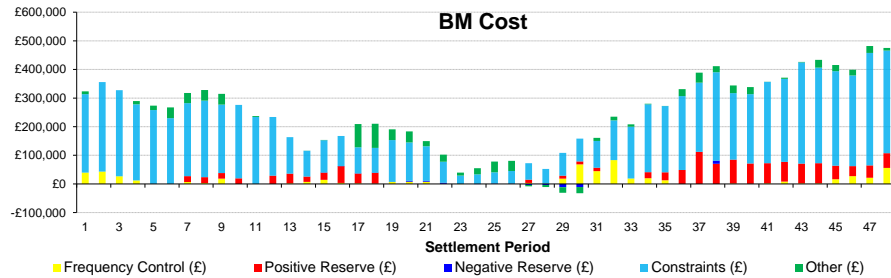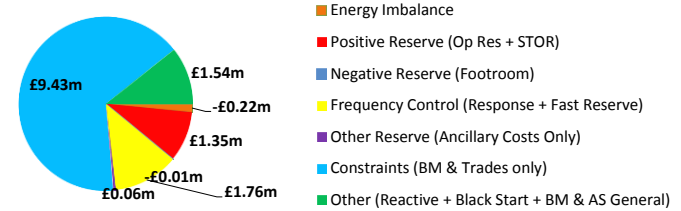

Commentary

A long market over the early hours, from early morning to late afternoon, and from late evening onwards. Interconnector Trades were required for Downward Regulation between 5am and 7am in the morning, and from 1pm to 3pm in the afternoon. 232MW of Non-BM Fast Reserve was run over the evening Darkness Peak. Overnight Voltage Control supported by Trades and BM Action. BM Action overnight for System Inertia. BM Action required throughout the day to alleviate thermal export constraints in Scotland and the North of England.