

Date:


Tuesday 01 Mar 2022

BSUoS Charge Estimate: £3.87/MWh

Total Outturn: £5.25m





BM Cost (Indicative)

AS Cost (Estimate)



## Daily Balancing Costs

nationalgridESO

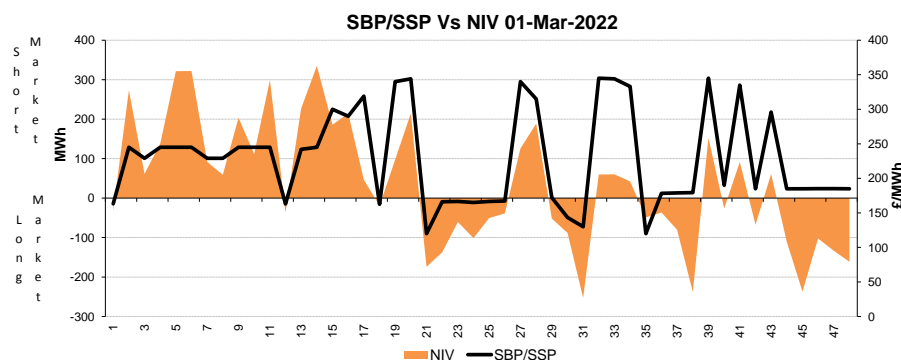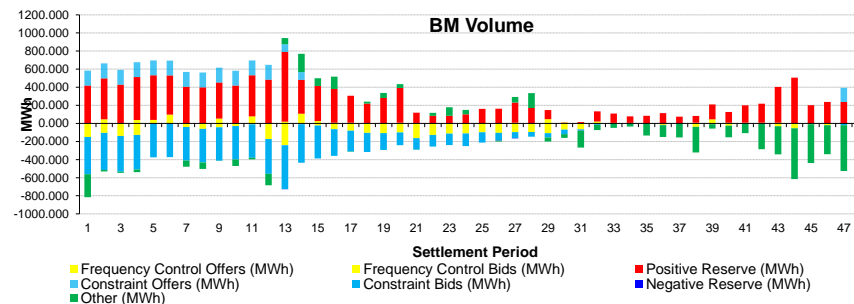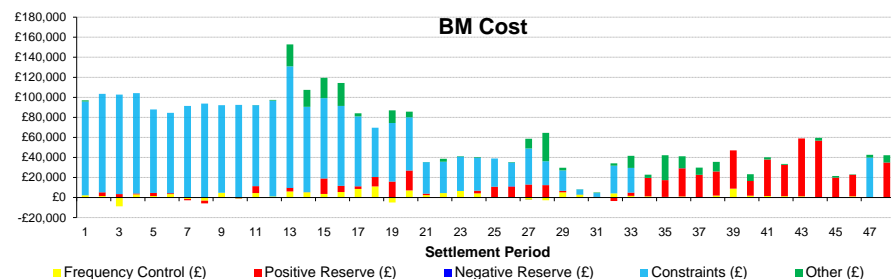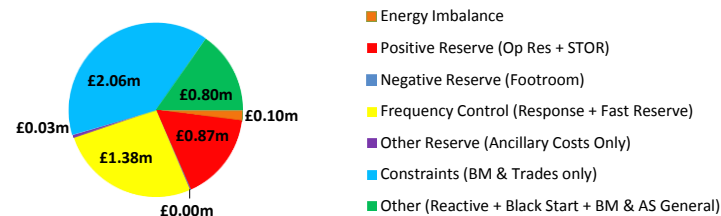

### Commentary

A short market overnight to late morning. 111MW of Non-BM Fast Reserve was run over the early morning period. Interconnector Trades for Margin were required between 6am and 7am in the morning. Overnight Trades and BM Action for Voltage Control in the Midlands and South East of England. BM Action was required during the early hours for thermal export constraints in Scotland.