
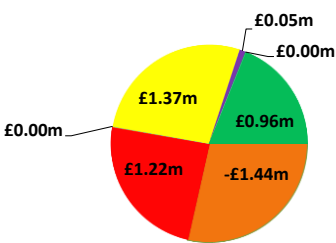


Date: Sunday 27 Mar 2022




BSUoS Charge Estimate: £2.69/MWh  
Total Outturn: £2.18m

Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

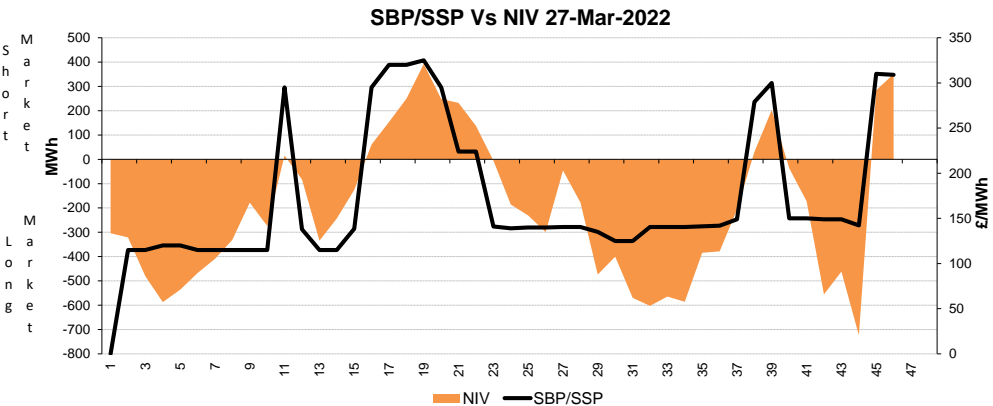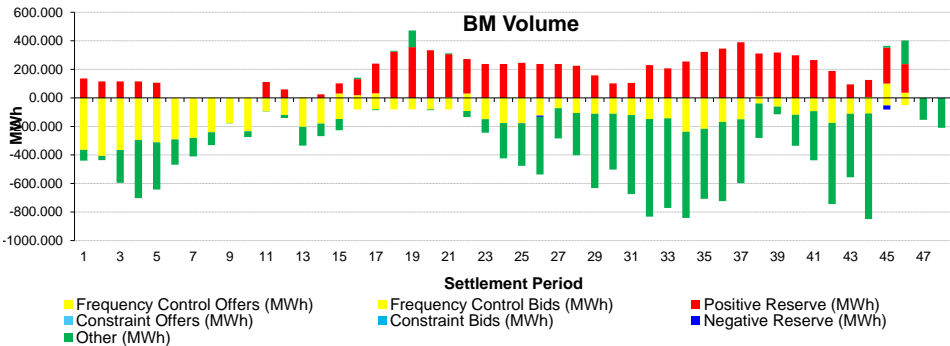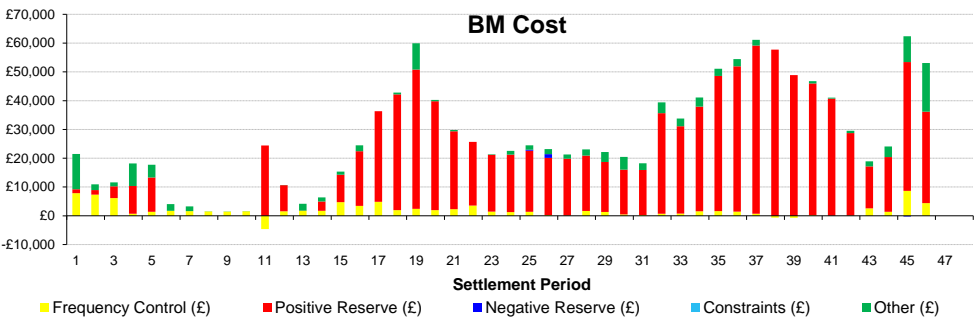

Commentary

The market was short in excess of 800MW in the morning.  
No BM intervention or trade action was required throughout the 24 hours.