
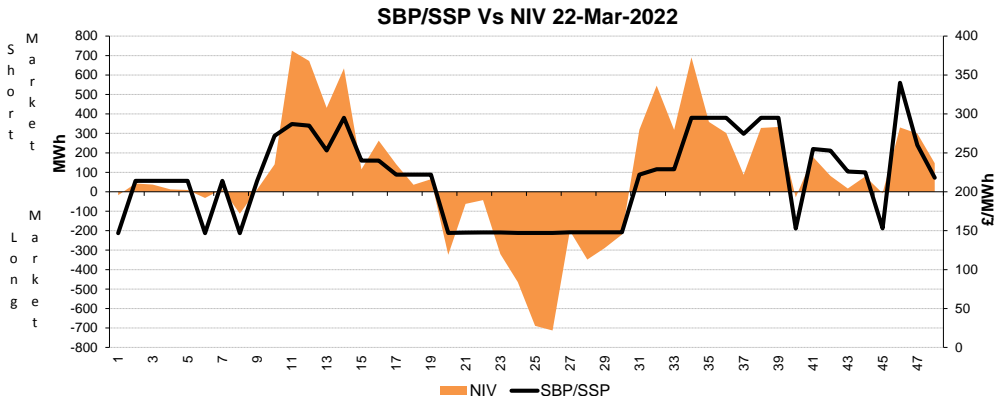
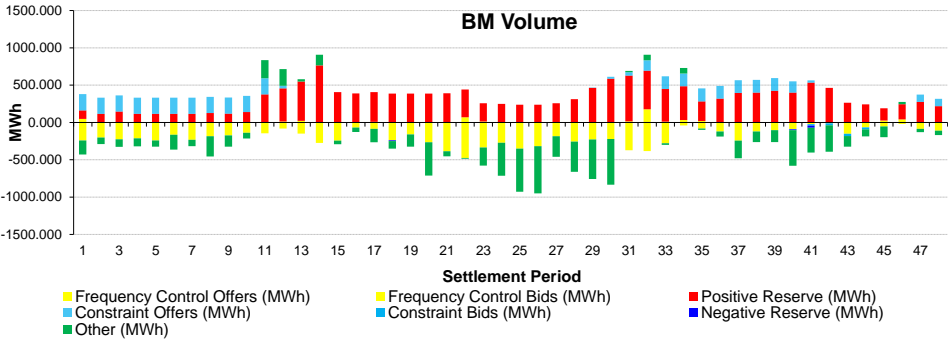
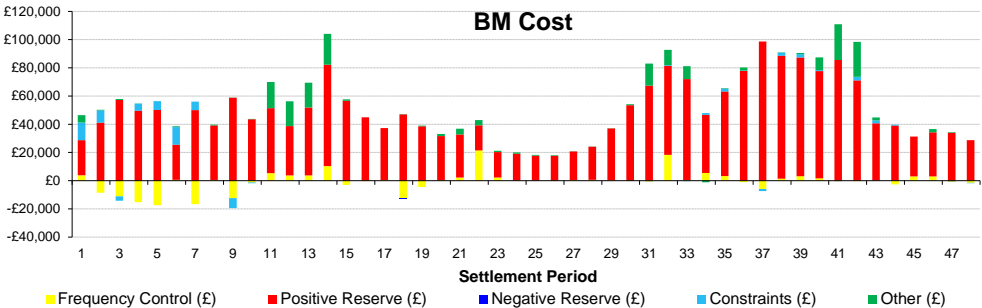
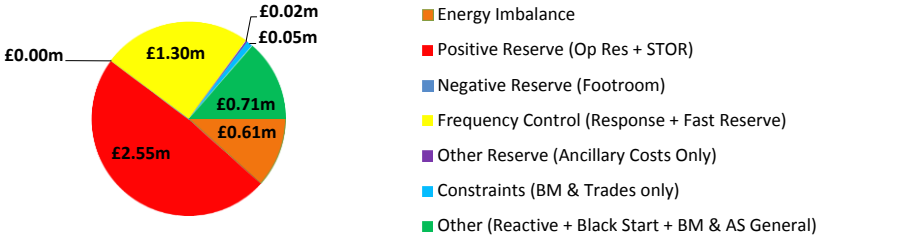


Date: **Tuesday 22 Mar 2022**
 BSUoS Charge Estimate: **£4.48/MWh**
 Total Outturn: **£5.24m**

Daily Balancing Costs

BM Cost (Indicative)
 AS Cost (Estimate)



Commentary

A short market over the early morning period and from the mid afternoon onwards into the night. Interconnector Trades were required for Margin between 5am and 7am in the morning, and during the late afternoon and the evening.

Overnight Voltage Control supported by Trades in the Midlands and the South East of England, and with BM Action for the East of England. BM Action was required from midday onwards to the early evening for power flow constraints across the North of England to the South. BM Action alleviated localised thermal export constraints in the North of Scotland during the evening period.