

Date:


Saturday 09 Oct 2021

BSUoS Charge Estimate: £3.89/MWh

Total Outturn: £3.86m


BM Cost (Indicative)

AS Cost (Estimate)






## Daily Balancing Costs

**nationalgrid**ESO



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

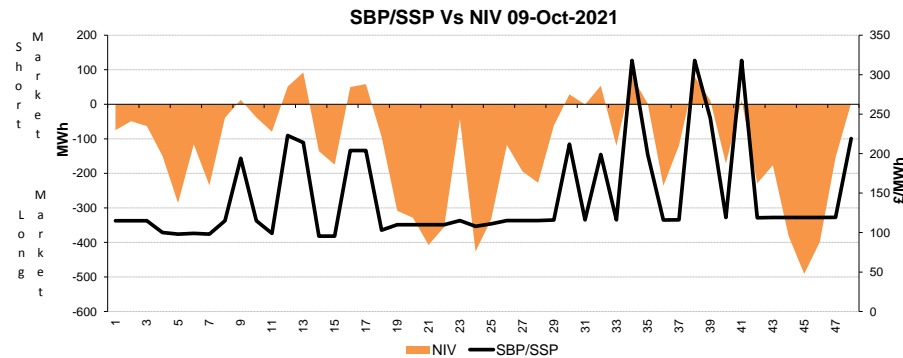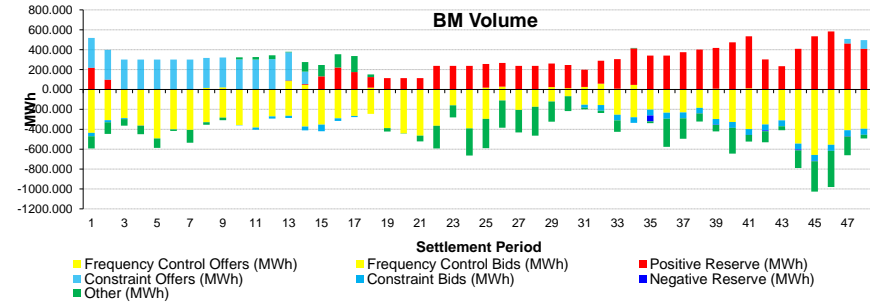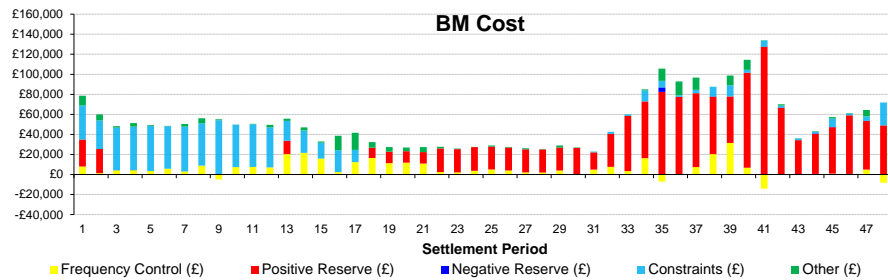

### Commentary

A mostly long market throughout the day.

BM Action supported Voltage Control overnight in the Midlands and South East of England. Some BM Action required briefly for thermal export constraints in Scotland and the South of England during the early morning. BM Action alleviated thermal export constraints in the Wales area from mid afternoon onwards.