



Date: Tuesday 14 Sep 2021

BSUoS Charge Estimate: £17.85/MWh
Total Outturn: £23.34m




Daily Balancing Costs

BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

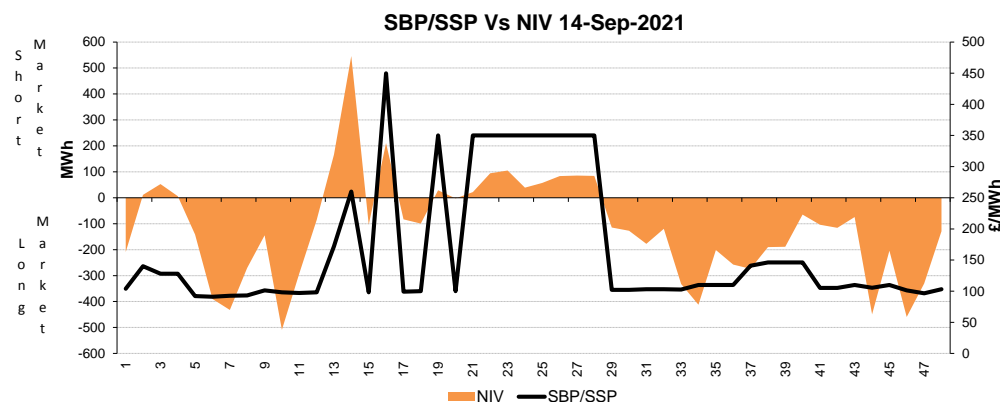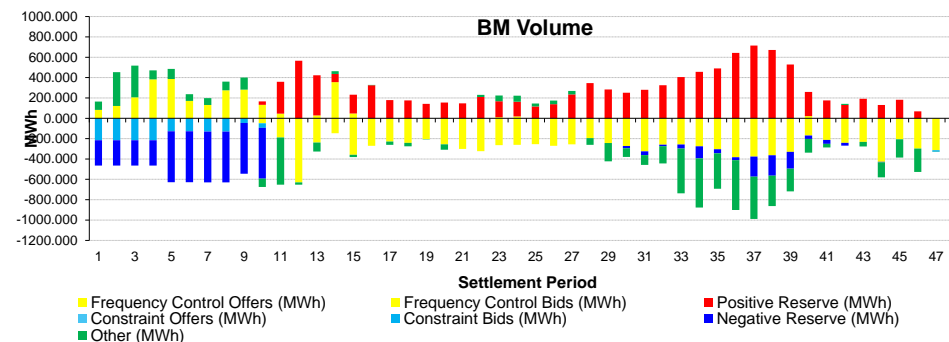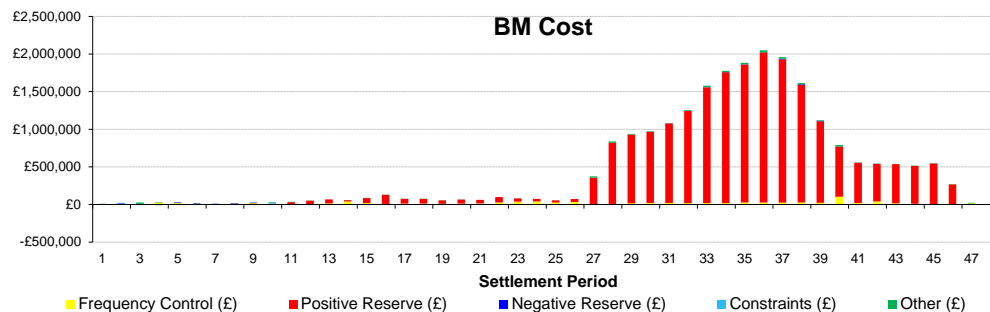

Commentary

A long market overnight to the early morning, and from 2pm onwards into the night. Interconnector Trades for Downward Regulation overnight to 5am, and for Margin between 5am and 6am. 230MW of STOR was run over the late afternoon.

Trades overnight for RoCoF.