

Date:


Sunday 19 Sep 2021

BSUoS Charge Estimate: £2.72/MWh

Total Outturn: £2.24m


BM Cost (Indicative)

AS Cost (Estimate)






## Daily Balancing Costs

nationalgridESO



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

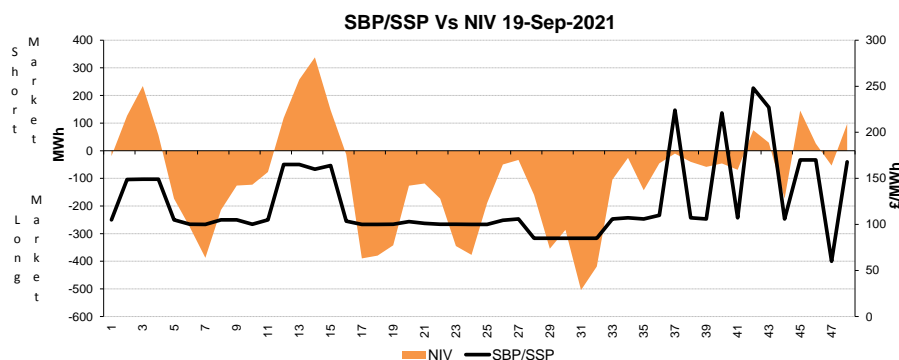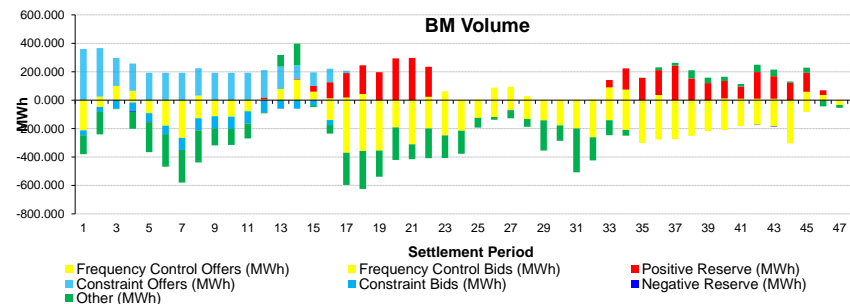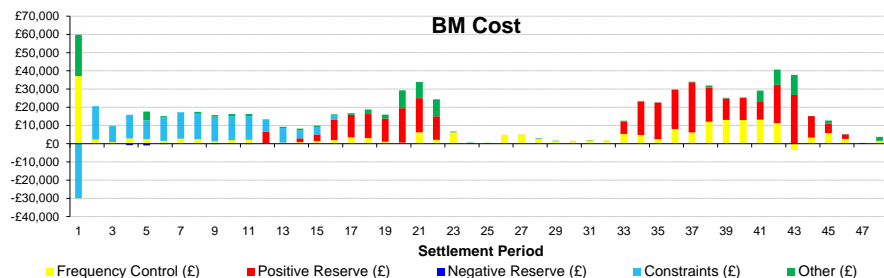

### Commentary

The market was prevalently long throughout the 24 hours.

Overnight, trades on the interconnectors were undertaken to mitigate RoCoF risk and offers were accepted in the BM to manage the voltage levels in England.