






Date: Saturday 25 Sep 2021

BSUoS Charge Estimate: £4.67/MWh
Total Outturn: £4.75m

BM Cost (Indicative)
AS Cost (Estimate)



Daily Balancing Costs

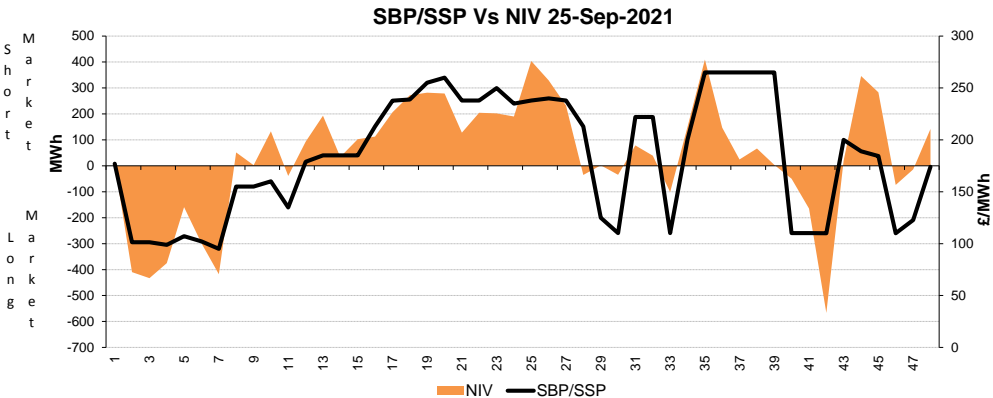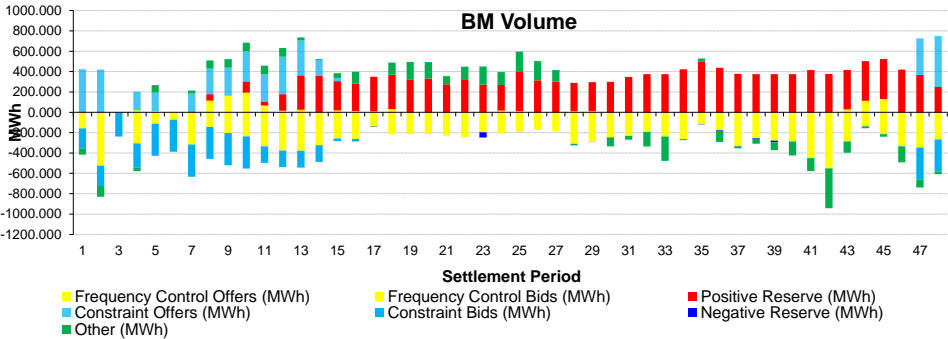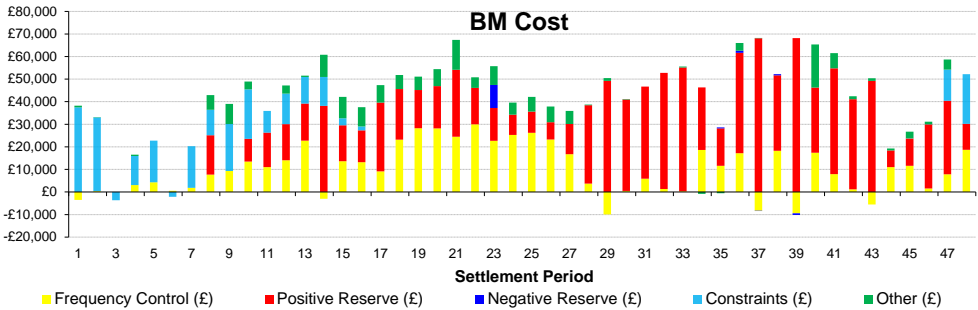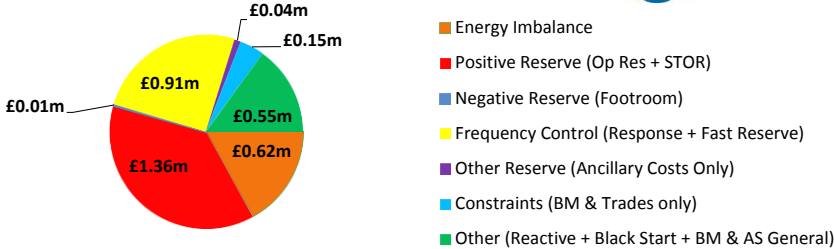

Commentary

The market position was changeable but mostly short through the daytime.

Overnight interconnector trades were made for RoCoF. An optional contract enactment, trades and BM actions were required for voltage management.