



Date: Tuesday 07 Sep 2021




BSUoS Charge Estimate: £12.64/MWh  
Total Outturn: £15.38m

Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

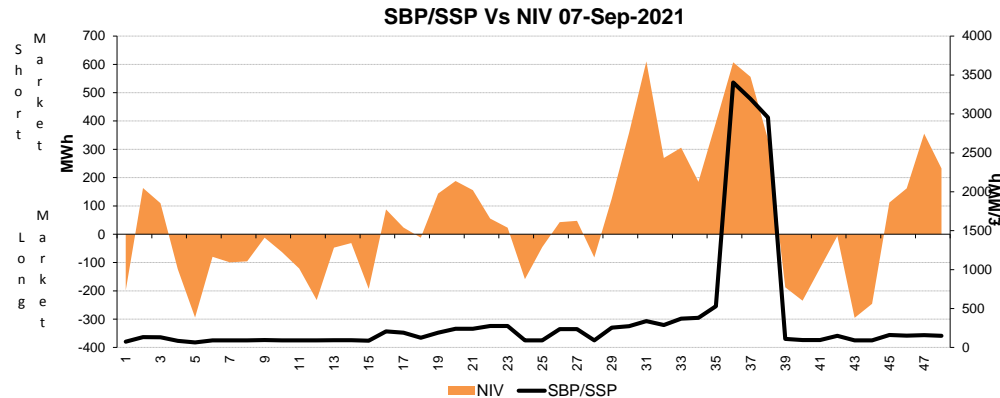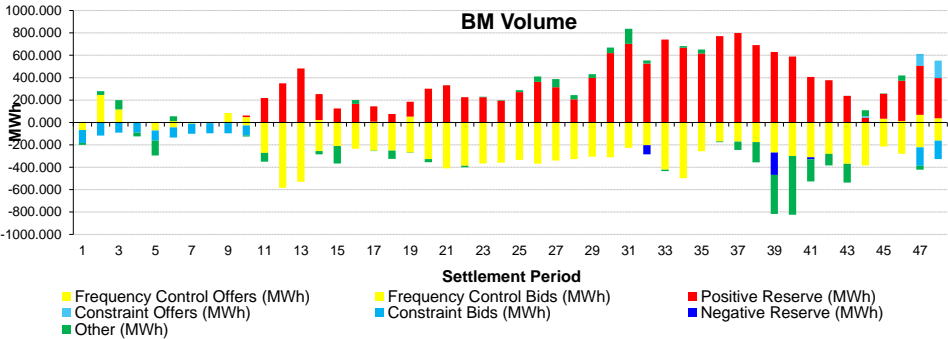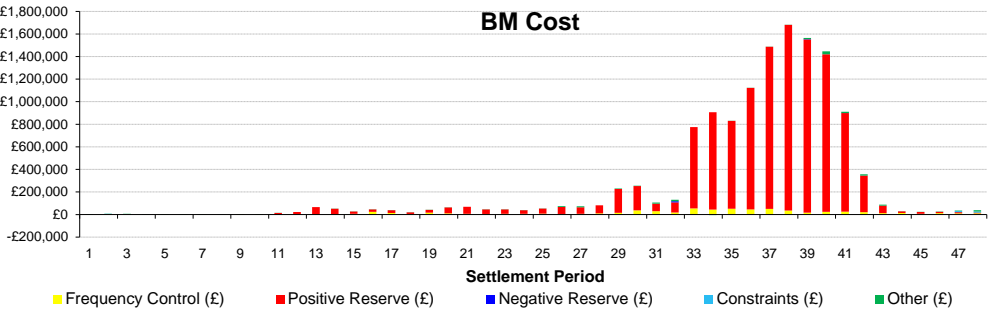

Commentary

A short market during the early hours, becoming long mainly over the late morning, midday, and afternoon to early evening periods. Interconnector Trades for Margin were required between 6am and 7am. 230MW of STOR was run over the late afternoon to evening. Trades overnight for RoCoF. BM Action supported Voltage Control in the Midlands overnight.